

Table of Contents

Introduction	2
Motor Control	4
Power Supplies	8
Design Standards	13
Need for Circuit Protection	14
Overcurrent-Protection Devices	19
Motor Control Centers	23
Combination Motor Control Units	30
Motor Starters	35
Pilot Devices	40
Circuit Breakers	42
Other Types of Units in MCCs	44
MCC Ratings	49
Enclosures	52
Classification and Types of Wiring	55
Cable Entry	60
System/89	64
Model 95 Plus	74
Information Needed to Order MCCs	81
Review Answers	83
Final Exam	84

Introduction

Welcome to another course in the STEP 2000 series, **Siemens Technical Education Program**, designed to prepare our distributors to sell Siemens Energy & Automation products more effectively. This course covers **Motor Control Centers**.

Upon completion of **Motor Control Centers**, you should be able to:

- Explain the role of motor control centers in a distribution system
- Define a motor control center according to NEMA and UL
- Explain the need for circuit protection
- Identify various components of a motor control center
- Explain the difference between the various classifications and types of MCC wiring
- Explain similarities and differences between the System/89™ and the Model 95 Plus motor control centers

This knowledge will help you better understand customer applications. In addition, you will be better prepared to describe motor control products to customers. You should complete **Basics of Electricity** and **Basics of Control Components** before attempting **Motor Control Centers**.

If you are an employee of a Siemens Energy & Automation authorized distributor, fill out the final exam tear-out card and mail in the card. We will mail you a certificate of completion if you score a passing grade. Good luck with your efforts.

Sensitrip is a registered trademark of Siemens Energy & Automation, Inc.

Sentron, ESP100, INNOVA PLUS, System/89, ACCESS, and SAMMS are trademarks of Siemens Energy & Automation, Inc.

National Electrical Code[®] and NEC[®] are registered trademarks of the National Fire Protection Association, Quincy, MA 02269. Portions of the National Electrical Code are reprinted with permission from NFPA 70-1996, National Electrical Code Copyright, 1995, National Fire Protection Association, Quincy, MA 02269. This reprinted material is not the complete and official position of the National Fire Protection Association on the referenced subject which is represented by the standard in its entirety.


Underwriters Laboratories Inc. and UL are registered trademarks of Underwriters Laboratories Inc., Northbrook, IL 60062.

National Electrical Manufacturers Association is located at 2101 L Street, N.W., Washington, D.C. 20037. The abbreviation "NEMA" is understood to mean National Electrical Manufacturers Association.

Other trademarks are the property of their respective owners.


Motor Control

Distribution systems used in large commercial and industrial applications can be complex. Power may be distributed through various switchboards, transformers, and panelboards. Power distributed throughout a commercial or industrial application is used for a variety of applications such as heating, cooling, lighting, and motor-driven machinery.

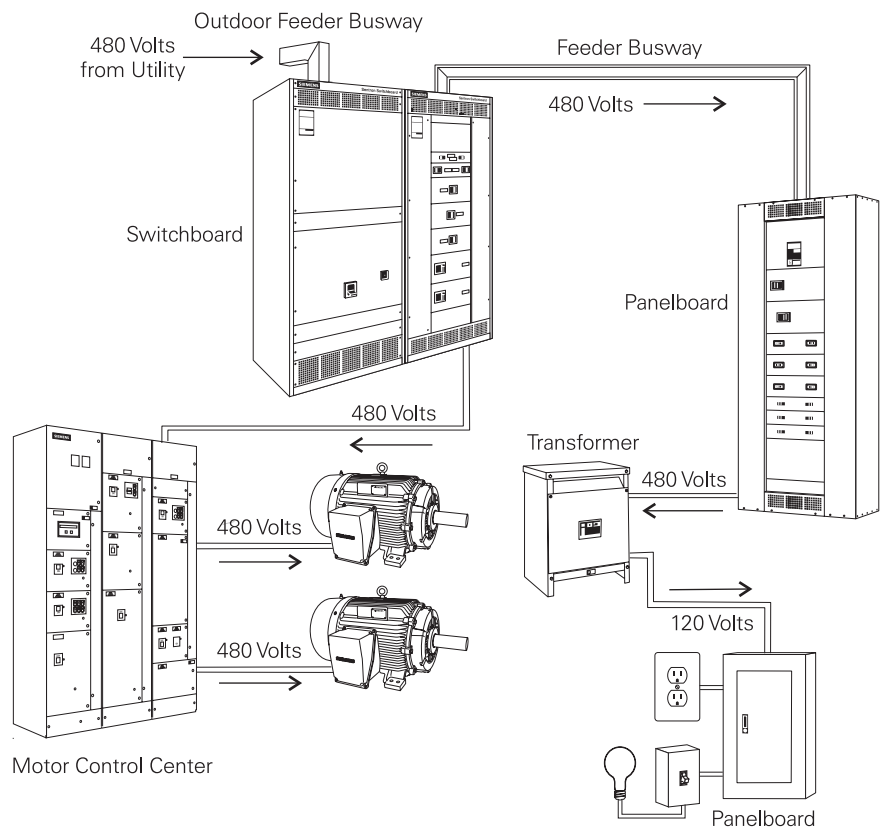


Basic Motor Control


Wherever motors are used, they must be controlled. In **Basics of Control Components** you learned how various control products are used to control the operation of motors. The most basic type of AC motor control, for example, involves turning the motor on and off. This is often accomplished by using a motor starter, which is made up of a contactor and an overload relay. The contactor's contacts are closed to start the motor and opened to stop the motor. This is accomplished electromechanically using start and stop pushbuttons or other pilot devices wired to control the contactor. The overload relay protects the motor by disconnecting power to the motor when an overload condition exists. An overload could occur, for instance, when a conveyor is jammed. Although the overload relay provides protection from overloads, it does not provide short-circuit protection for the wiring providing power to the motor. For this reason, a circuit breaker or fuses are also used.

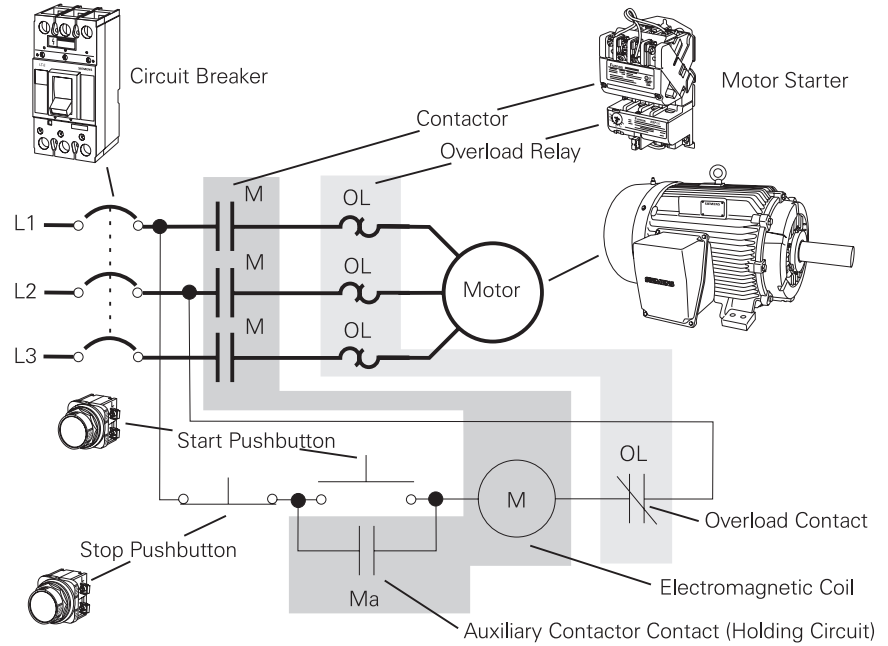

Typically one motor starter controls one motor. When only a few geographically dispersed AC motors are used, the circuit protection and control components may be located in a panel near the motor.



In many commercial and industrial applications quite a few electric motors are required, and it is often desirable to control some or all of the motors from a central location. The apparatus designed for this function is the motor control center (MCC). Motor control centers are simply physical groupings of combination starters in one assembly. A combination starter is a single enclosure containing the motor starter and the fuses or circuit breaker.

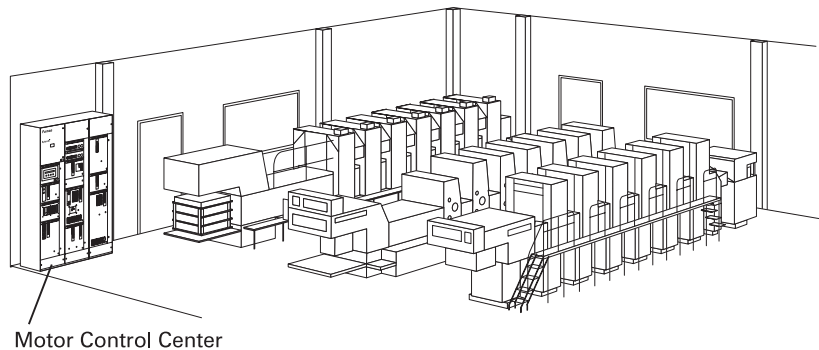


Advantages of MCCs

Some of the advantages of using a motor control center are:


- Faster and easier installation and wiring
- Centralized motor control
- Generally less total space is required
- Neat, attractive appearance
- Simplicity in adding special components such as service entrance switches, load centers, and transformers
- Ease of future modifications, such as increasing the size of the starters, adding additional starters, or adding additional vertical sections.

Siemens Motor Control Centers

Siemens manufactures two motor control centers, the Model 95 Plus and the System/89™.

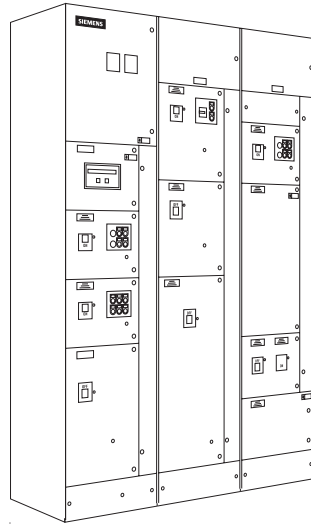


Model 95 Plus

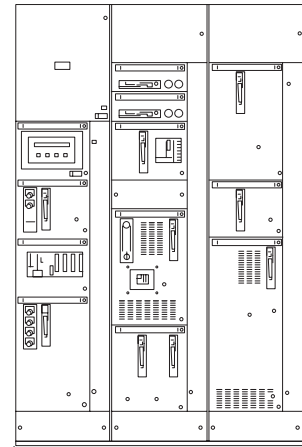

System 89


Power Supplies

The major source of electrical power used by motor control centers is an AC generator located at a power-generating facility. AC generators operate on the theory of electromagnetic induction. This simply means that when conductors are moved through a magnetic field, a voltage is induced into the conductors. A basic generator consists of a magnetic field, an armature, slip rings, brushes, and some type of resistive load. An armature is any number of conductive wires (conductors) wound in loops which rotate through the magnetic field. For simplicity, one loop is shown.

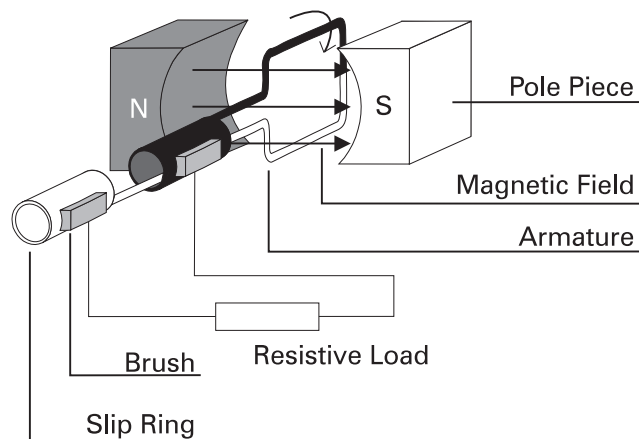


If the rotation of the AC generator were tracked through a complete revolution of 360° , it could be seen that during the first quarter of a revolution voltage would increase until it reached a maximum positive value at 90° . Voltage would decrease during the second quarter of revolution until it reached zero at 180° . During the third quarter of a revolution voltage would increase in the opposite direction until it reached a maximum negative value at 270° . During the last quarter of a revolution voltage would decrease until it reached zero at 360° . This is one complete cycle or one complete alternation between positive and negative.

If the armature of the AC generator were to rotate 3600 times per minute (RPM) we would get 60 cycles of voltage per second, or 60 hertz. Most alternators have more than two poles and one loop of wire. Alternators can have two or three pairs of electromagnetic poles, allowing the AC generator to generate voltage at 60 Hz at slower speeds.

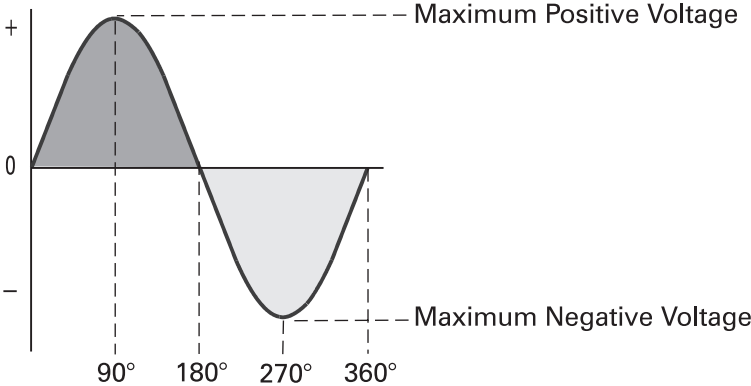


Three-Phase Voltage

In most large commercial and industrial motor applications three-phase voltage is used. In a three-phase system the generator produces three voltages. Each voltage phase rises and falls at the same frequency (60 Hz in the U.S., 50 Hz in many other countries); however, the phases are offset by 120° from each other.

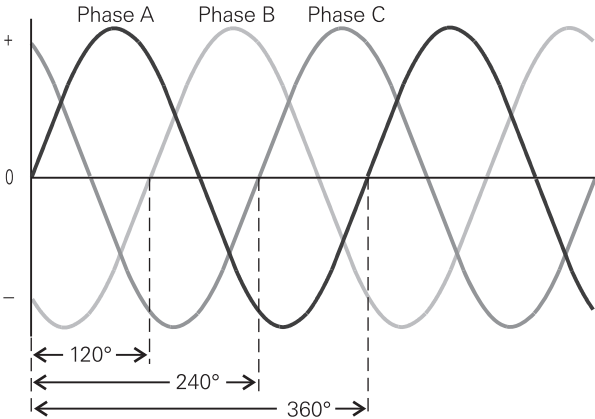


The motor control center receives this power through complex distribution systems which include power distribution lines, transformers, substations, and switchboards. Transformers used with three-phase power require three interconnected coils in both the primary and the secondary. These transformers can be connected in either a wye or a delta configuration. The type of transformer and the actual voltage depend on the requirements and capability of the power company and the needs of the customer. The following illustration shows the secondary of a wye-connected transformer and the secondary of a delta-connected transformer.

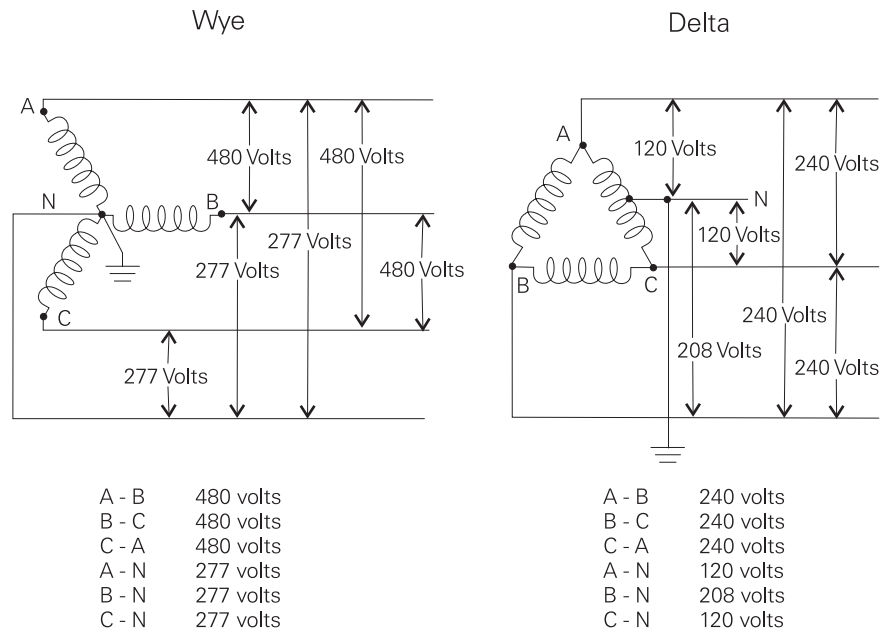


Motor Rotation

Three-phase voltage is used throughout large commercial and industrial facilities to run AC motors. An AC motor is made up of a stationary member, called a stator, and a rotating member, called a rotor. Three-phase AC power is applied to the stator through the power connections.

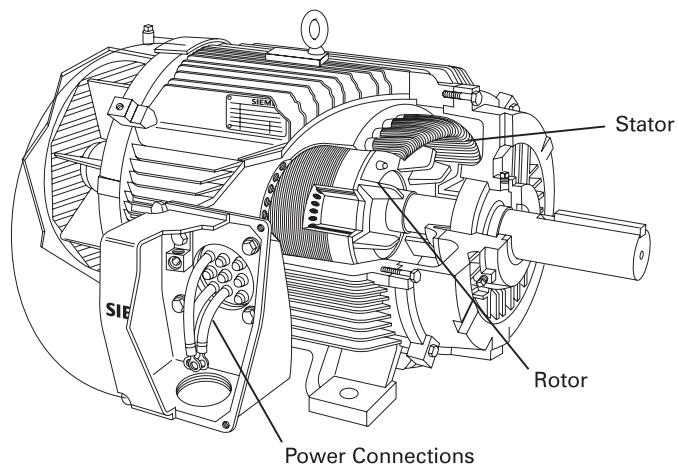


Motor Rotation


The direction a three-phase AC motor rotates depends on the phase sequence of the incoming power supply. In the following example, L1 (A) is connected to motor lead T1, L2 (B) is connected to motor lead T2, and L3 (C) is connected to motor lead T3. When power is applied through the "F" contacts the motor will turn in a clockwise, or forward direction.

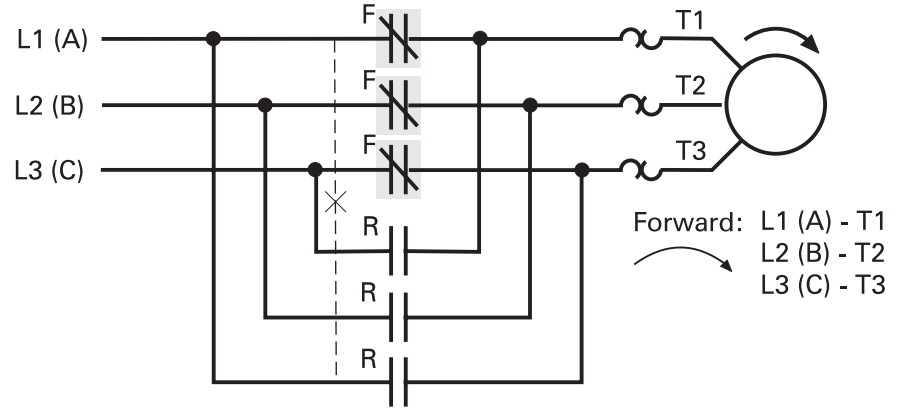

However, by reversing any two of the three power supply leads, the motor will run in the opposite direction. In this example L1 (A) is connected to motor lead T3, L2 (B) is connected to motor lead T2, and L3 (C) is connected to motor lead T1 (L1 and L3 have been reversed). When power is applied through the "R" contacts the motor will run in the counterclockwise, or reverse direction.

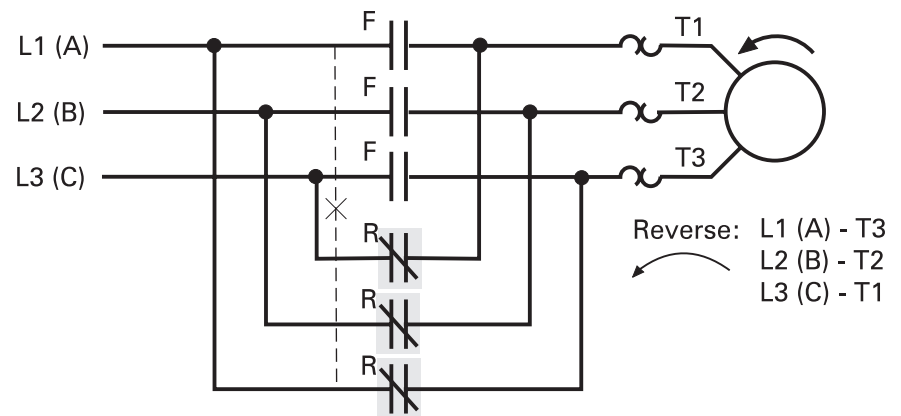

Many applications are designed for forward and reverse operation. An overhead crane, for example, might use the forward direction to raise the crane and reverse direction to lower the crane.

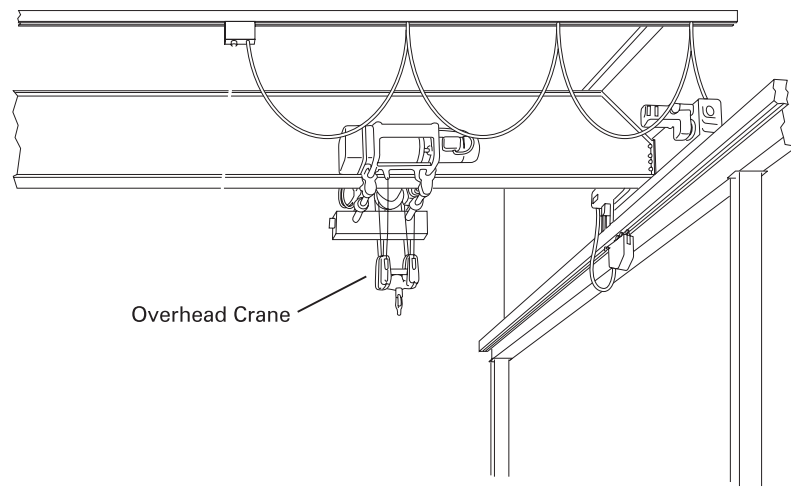

However, the consequences of running a motor in the reverse direction on an application designed to run only in the forward direction can be disastrous, resulting in equipment damage and possibly injury or loss of life.

Review 1

1. Which of the following is an advantage of using a motor control center?
 - a. Faster and easier installation
 - b. Simplicity in adding special components
 - c. Ease of future modifications
 - d. All the above
2. The two models of motor control centers manufactured by Siemens are the _____ and the _____ .
3. In most large commercial and industrial motor applications _____ -phase voltage is used.
4. Motor rotation of a three-phase AC motor can be reversed by reversing any _____ of the three power-supply leads.

Design Standards

Although several organizations are involved in establishing standards for the design, construction, and application of motor control centers, the primary standards are established by UL, NEMA, and the National Electrical Code® (NEC®). The following organizations have established standards which may be applied to motor control centers. It is beyond the scope of this course to cover every standard; however, reference will be made throughout the course to many important standards with which Siemens motor control centers comply.

UL

Underwriters Laboratories (UL) is a private company that is nationally recognized as an independent testing laboratory. UL tests products for safety and products that pass UL tests can carry a UL mark. Siemens motor control centers are designed to UL 845 standards.

NEMA

The National Electrical Manufacturers Association (NEMA) is an organization that, among other things, develops standards for electrical equipment.

NEC

The National Fire Protection Association (NFPA) is a nonprofit organization which publishes the *National Electrical Code*® (NEC®). The intent of the NEC® is to describe safe electrical practices.

ANSI

The American National Standards Institute (ANSI) is a nongovernmental organization that facilitates the development of standards by establishing a consensus among qualified groups.

IEEE

The Institute of Electrical and Electronic Engineers (IEEE) is an organization open to individual membership and provides a variety of services for its members. It also develops numerous standards for electrical and electronic equipment and practices.

IEC


The International Electrotechnical Commission (IEC) is an organization based in Geneva, Switzerland, with over 50 member nations. IEC writes standards for electrical and electronic equipment practices.

NEC® and National Electrical Code® are registered trademarks of the National Fire Protection Association.

Need for Circuit Protection

Current and temperature


Current flow in a conductor always generates heat. The greater the current flow in any one size conductor, the hotter the conductor. Excess heat is damaging to electrical components and conductor insulation. For that reason conductors have a rated, continuous current-carrying capacity or ampacity. Overcurrent protection devices, such as fuses, are used to protect conductors from excessive current flow.

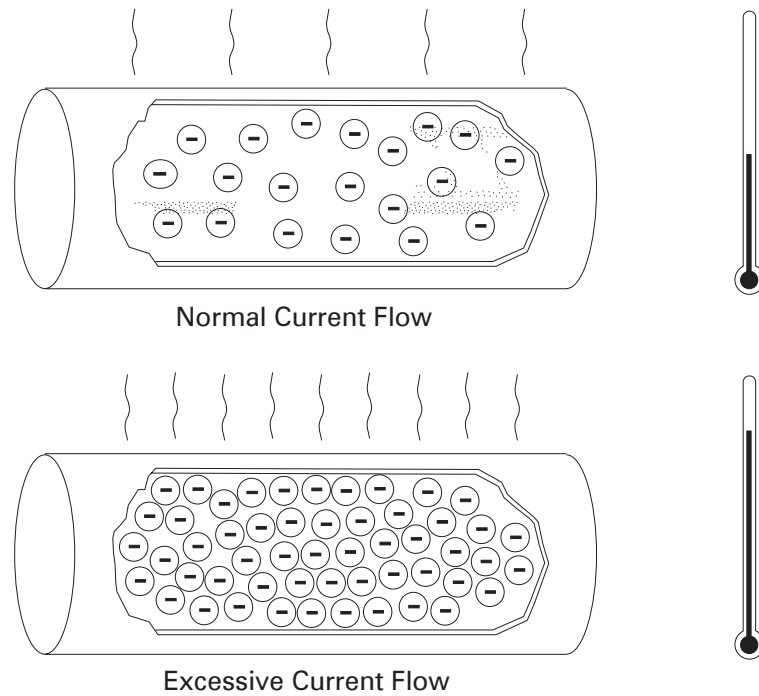

Excessive current is referred to as overcurrent. The *National Electrical Code*[®] defines overcurrent as *any current in excess of the rated current of equipment or the ampacity of a conductor. It may result from overload, short circuit, or ground fault* (Article 100-definitions).

Overloads


An overload occurs when too many devices are operated on a single circuit, or a piece of electrical equipment is made to work harder than it is rated design. For example, a motor rated for 10 amperes may draw 20, 30, or more amperes in an overload condition. In the following illustration, a package has become jammed on a conveyor, causing the motor to work harder and draw more current. Because the motor is drawing more current, it heats up. Damage will occur to the motor in a short time if the problem is not corrected or if the circuit is not shut down by the overcurrent protector.

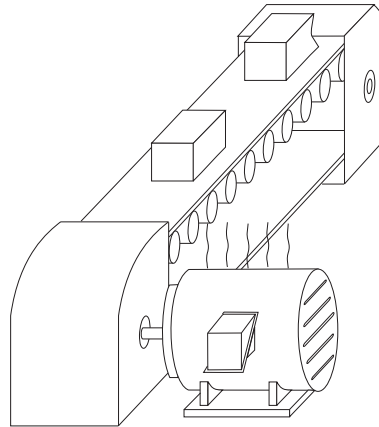


Conductor insulation

Motors, of course, are not the only devices that require circuit protection for an overload condition. Every circuit requires some form of protection against overcurrent. Heat is one of the major causes of insulation failure of any electrical component. High levels of heat to insulated wire can cause the insulation to breakdown, melt, or flake off, exposing conductors.

Good Insulation

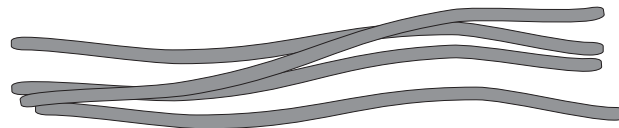


Insulation Affected by Heat

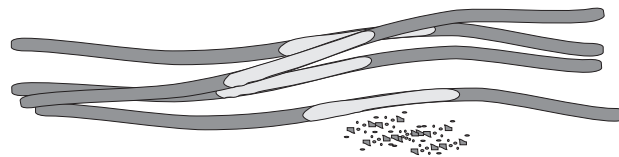

Short circuits

When two bare conductors touch, a short circuit occurs. When a short circuit occurs, resistance drops to almost zero. Short circuit current can be thousands of times higher than normal operating current.

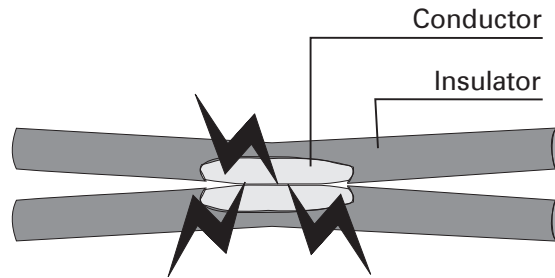

Ohm's Law demonstrates the relationship of current, voltage, and resistance. For example, a 240 volt motor with 24 Ω (ohms) of resistance would normally draw 10 amperes of current.

$$I = \frac{E}{R}$$

$$I = \frac{240}{24}$$

$$I = 10 \text{ amperes}$$


When a short circuit develops, resistance drops. If resistance drops to 24 milliohms, current will be 10,000 amperes.

$$I = \frac{240}{.024}$$


$$I = 10,000 \text{ amperes}$$

Short-circuit current on unprotected electrical circuits

When a short circuit occurs, current will continue to flow in an unprotected electrical circuit. The peak short-circuit current of the first cycle is the greatest and is referred to as peak let-thru current (I_P). The force of this current can cause damage to wires, switches, and other electrical components of a circuit.

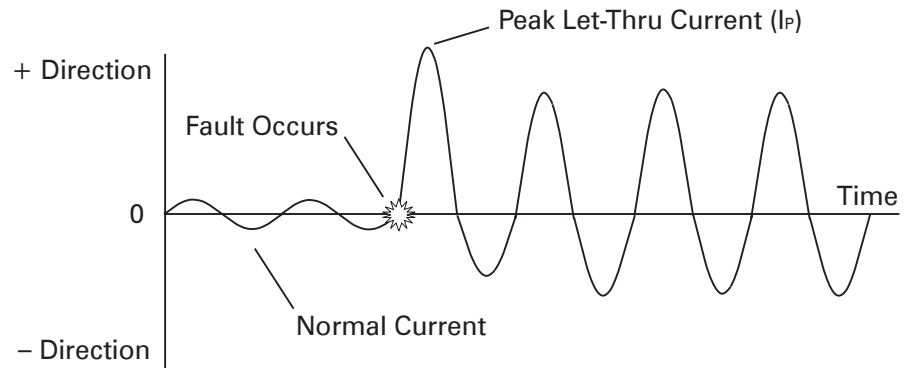


There is also energy let-thru (I^2t). This destructive thermal force is capable of melting conductors.

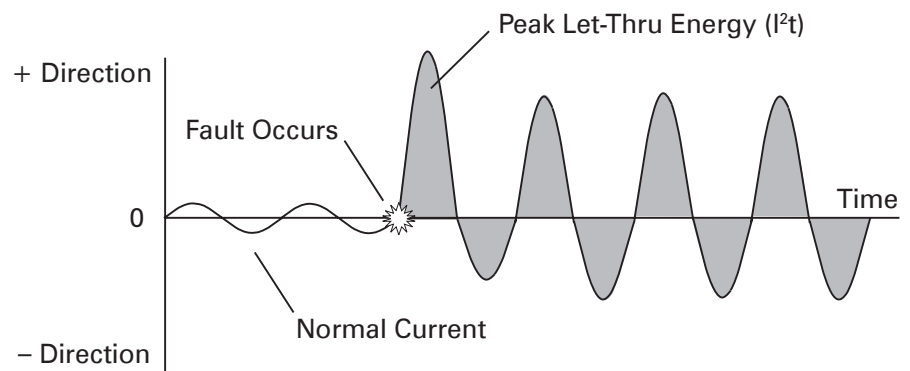

Short-circuit current on protected electrical circuits

A properly used, overcurrent-protection device will open the circuit quickly, limiting peak let-thru current (I_P) and energy (I^2t).

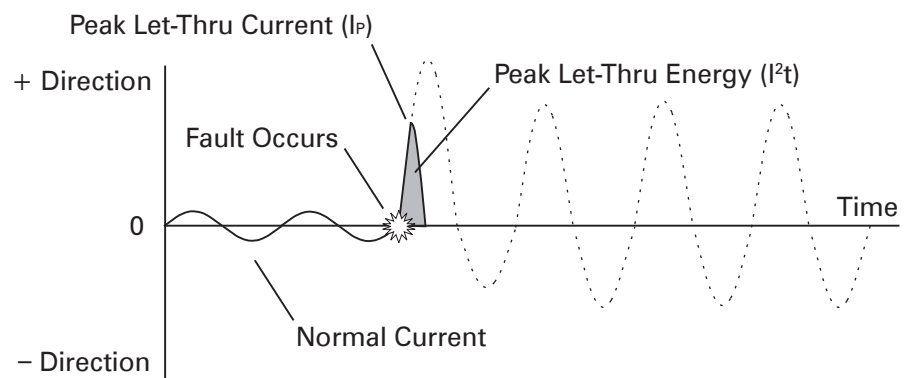

Article 240

Circuit protection would be unnecessary if overloads and short circuits could be eliminated. Unfortunately, overloads and short circuits do occur.

Article 240 of the *NEC*[®] covers overcurrent protection. You are encouraged to become familiar with this material. Article 240-1 states that:


Overcurrent protection for conductors and equipment is provided to open the circuit if the current reaches a value that will cause an excessive or dangerous temperature in conductors or conductor insulation.

Article 430-94

The *National Electrical Code*[®] requires overcurrent protection for motor control centers. *NEC*[®] article 430-94 states:

Motor control centers shall be provided with overcurrent protection in accordance with Article 240 based on the rating of the common power bus. This protection shall be provided by (1) an overcurrent-protective device located ahead of the motor control center or (2) a main overcurrent-protective device located within the motor control center.

There are two ways Article 430-94 can be met. An overcurrent-protection device can be installed ahead of the motor control center. A switchboard, for example, located upstream of the motor control center may contain the overcurrent-protection device for the motor control center. The second way to meet this requirement is to install a main over-current protection device within the motor control center.

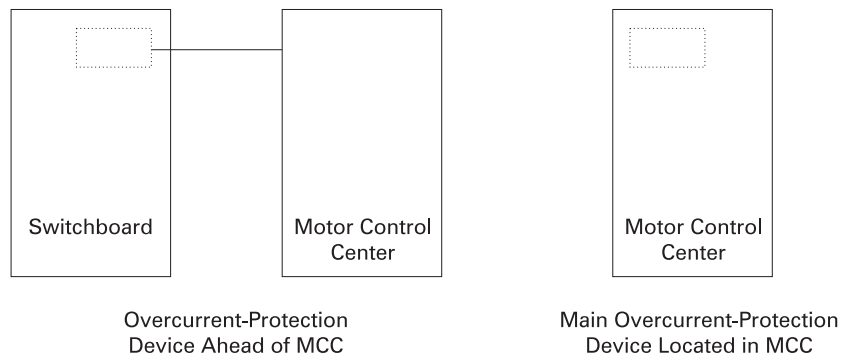


Overcurrent-Protection Devices

An overcurrent-protection device must be able to recognize the difference between an overcurrent and short circuit and respond in the proper way. Slight overcurrents can be allowed to continue for some period of time; but as the current magnitude increases, the protection device must open faster. Short circuits must be interrupted instantly.


Fusible Disconnect Switch

A fusible disconnect switch is one type of device used to provide overcurrent protection. Properly sized fuses located in the switch open the circuit when an overcurrent condition exists.

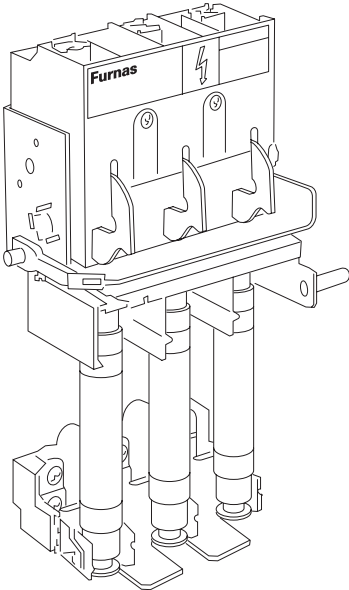

Fuse

A fuse is a one-shot device. The heat produced by overcurrent causes the current carrying element to melt open, disconnecting the load from the source voltage.

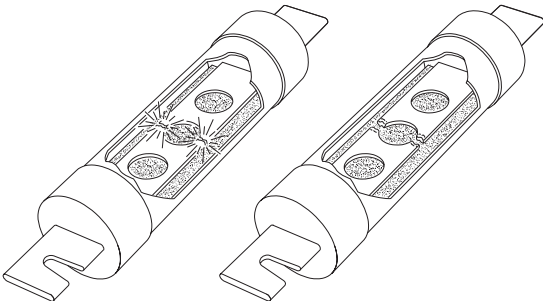

Nontime-Delay Fuses

Nontime-delay fuses provide excellent short-circuit protection. When an overcurrent occurs, heat builds up rapidly in the fuse. Nontime-delay fuses usually hold 500% of their rating for approximately one-fourth second, after which the current-carrying element melts. This means that these fuses should not be used in motor circuits which often have inrush currents greater than 500%.

Time-Delay Fuses

Time-delay fuses provide overload and short-circuit protection. Time-delay fuses usually allow five times the rated current for up to ten seconds to allow motors to start.

Fuse Classes


Fuses are grouped into classes based on their operating and construction characteristics. Each class has an ampere interrupting capacity (AIC) which is the amount of fault current they are capable of interrupting without destroying the fuse casing. Fuses are also rated according to the maximum continuous current and maximum voltage they can handle. Underwriters Laboratories (UL) establishes and standardizes basic performance and physical specifications to develop its safety-test procedures. These standards have resulted in distinct classes of low-voltage fuses rated at 600 volts or less. The following chart lists the fuse class and its AIC rating.

Class	Voltage Rating	Ampere Rating	Interrupting Rating (Amps)	Sub Classes	UL Standard
R	250, 600	0-600	200,000	RK1 and RK5	UL 248 12
J	600	0-600	200,000		UL 248 B
L	600	601-6000	200,000		UL 248 10
CC	600	0-30	200,000		UL 248 4

Circuit Breakers

Another device used for overcurrent protection is a circuit breaker. The *National Electrical Code*® defines a circuit breaker as a device designed to open and close a circuit by nonautomatic means, and to open the circuit automatically on a predetermined overcurrent without damage to itself when properly applied within its rating.

Circuit breakers provide a manual means of energizing and de-energizing a circuit. In addition, circuit breakers provide automatic overcurrent protection of a circuit. A circuit breaker allows a circuit to be reactivated quickly after a short circuit or overload is cleared. Since it merely needs to be reset there is nothing to replace after a short circuit.

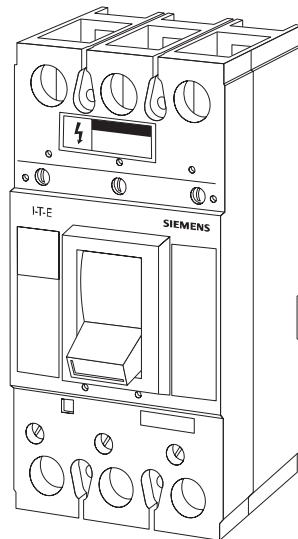

Ampere Rating

Like fuses, every circuit breaker has a specific ampere, voltage, and fault-current interruption rating. The ampere rating is the maximum continuous current a circuit breaker can carry without exceeding its rating. As a general rule, the circuit breaker ampere rating should not exceed the conductor ampere rating. For example, if the conductor is rated for 20 amps, the circuit breaker rating should not exceed 20 amps. Siemens breakers are rated on the basis of using 60° C or 75° C conductors. This means that even if a conductor with a higher temperature rating were used, the ampacity of the conductor must be figured on its 60° C or 75° C rating.

There are some specific circumstances when the ampere rating is permitted to be greater than the current-carrying capacity of the circuit. For example, motor and welder circuits can exceed conductor ampacity to allow for inrush currents and duty cycles within limits established by *NEC*®.

Generally the ampere rating of a circuit breaker is selected at 125% of the continuous load current. This usually corresponds to the conductor ampacity which is also selected at 125% of continuous load current. For example, a 125 amp circuit breaker would be selected for a load of 100 amps.

Voltage Rating

The voltage rating of the circuit breaker must be at least equal to the supply voltage. The voltage rating of a circuit breaker can be higher than the supply voltage, but never lower. For example, a 480 VAC circuit breaker could be used on a 240 VAC circuit. A 240 VAC circuit breaker could not be used on a 480 VAC circuit. The voltage rating is a function of the circuit breaker's ability to suppress the internal arc that occurs when the circuit breaker's contacts open.

Fault-Current Interrupting Rating

Circuit breakers are also rated according to the level of fault current they can interrupt. When applying a circuit breaker, one must be selected to sustain the largest potential short-circuit current which can occur in the selected application. Siemens circuit breakers have interrupting ratings from 10,000 to 200,000 amps.

Review 2

1. _____ is a private company that is nationally recognized as an independent testing laboratory.
2. The _____ publishes the *National Electrical Code*®
3. Class R fuses have an interrupting rating of _____ amps.
4. Installing an overcurrent protective device ahead of an MCC or installing a main overcurrent protective device within an MCC are two methods of meeting *NEC*® Article _____ .

Motor Control Centers

Motor Control Center

NEMA defines a motor control center in ICS-2-322 as being . . .


A floor-mounted assembly of one or more enclosed vertical sections having a horizontal common power bus and principally containing combination motor control units. These units are mounted one above the other in the vertical sections. The sections may incorporate vertical buses connected to the common power bus, thus extending the common power supply to the individual units. Units may also connect directly to the common power bus by suitable wiring.

According to the NEMA definition, motor control centers:

- Are floor-mounted assemblies
- Have one or more enclosed vertical sections
- Have a common horizontal power bus
- May incorporate vertical buses connected to the common bus
- Principally contain combination motor control units


Vertical Sections

The motor control center is made up of a steel structure to contain the combination motor control units, wireways, internal wiring, and bus bars. From the NEMA definition it can be seen that a motor control center is a floor-mounted assembly made up of enclosed vertical sections. One vertical section may stand alone as a complete motor control center, or several sections may be bolted and bussed together. Vertical sections are generally 20" wide by 90" high.

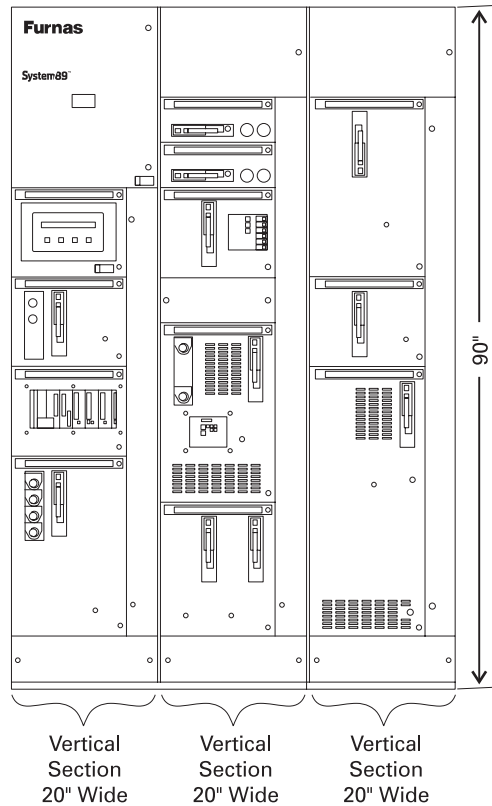


Horizontal and Vertical Bus

A bus is a conductor that serves as a common connection for two or more circuits. It is represented schematically by a straight line with a number of connections made to it.

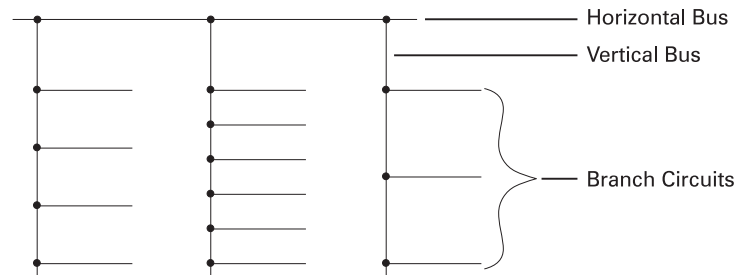


In power circuits, such as motor control centers, a bus is made of a heavy-duty metal bar. These bars provide power to each of the combination motor control units. The vertical bus is connected to a corresponding horizontal bus and is isolated from the other bus bars.

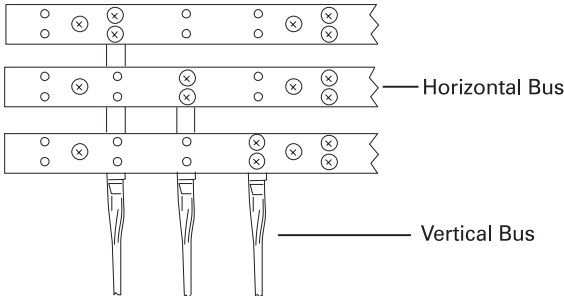

Bus Support


The NEC® discusses bus bars used in motor control centers in Article 430-97. Section a, Support and Arrangement, states that *busbars shall be protected from physical damage and be held firmly in place*. Bus bracing is very important due to the increased available fault current in today’s modern power systems. In this example of a Siemens motor control center the horizontal bus is firmly bolted to molded supports. The vertical bus is either encased in a molded support or supported by bus brackets, depending on which MCC is supplied.

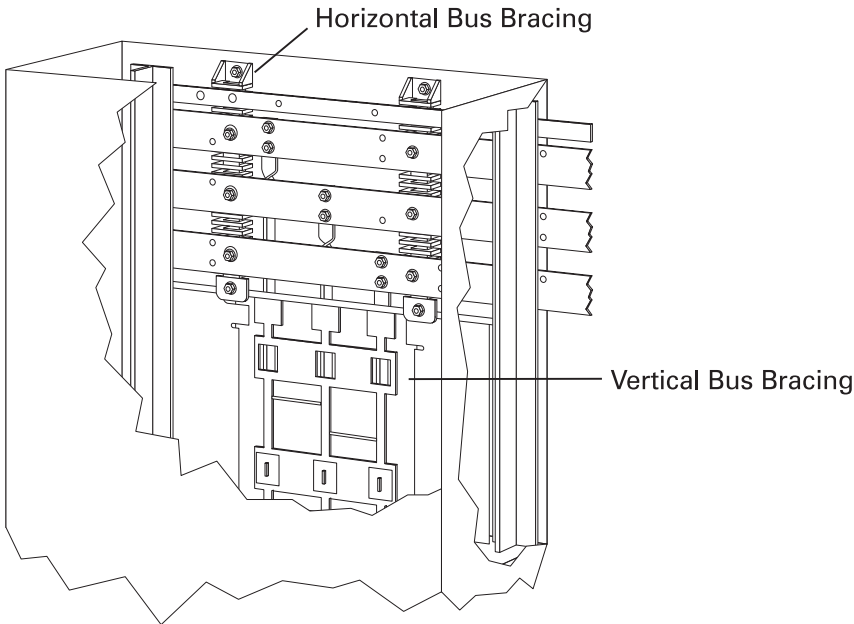

Reprinted with permission from NFPA 10-1996, *The National Electrical Code*®, Copyright® 1995, National Fire Protection Association, Quincy, MA 02269.


Bus Spacing

In addition, the *NEC*® Article 430-97 (d) requires 1" of clearance between a live bus and ground, 1" of clearance between phases through air, and 2" of clearance across a surface for voltages over 250 volts. These spacings are used throughout the horizontal and vertical bus in the MCC.

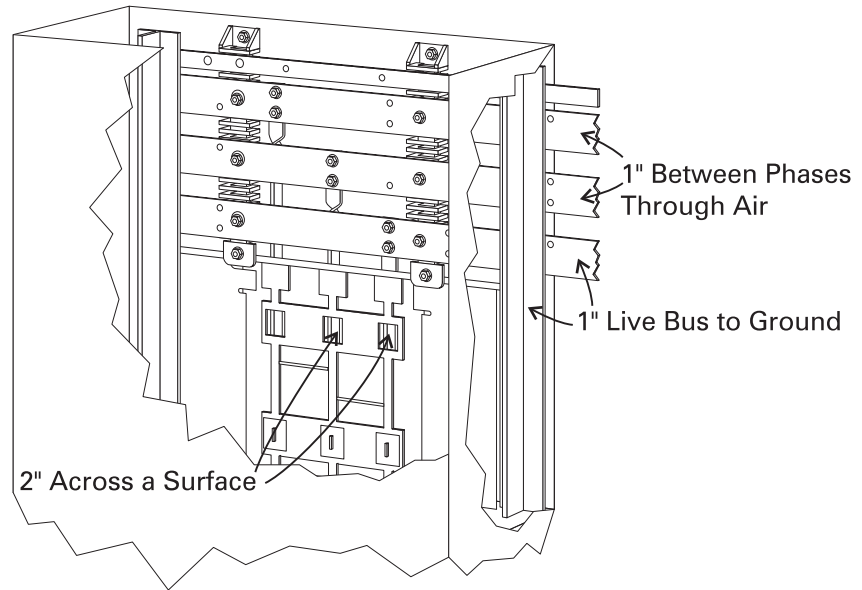


NEMA Phase Arrangement

NEMA requires bus bars to have phases in sequence so that an installer can have the same fixed phase arrangement at each termination point in any motor control center. The following diagram illustrates accepted NEMA phase arrangements. It is possible to have a non-NEMA phase sequence; however, this would have to be clearly marked.

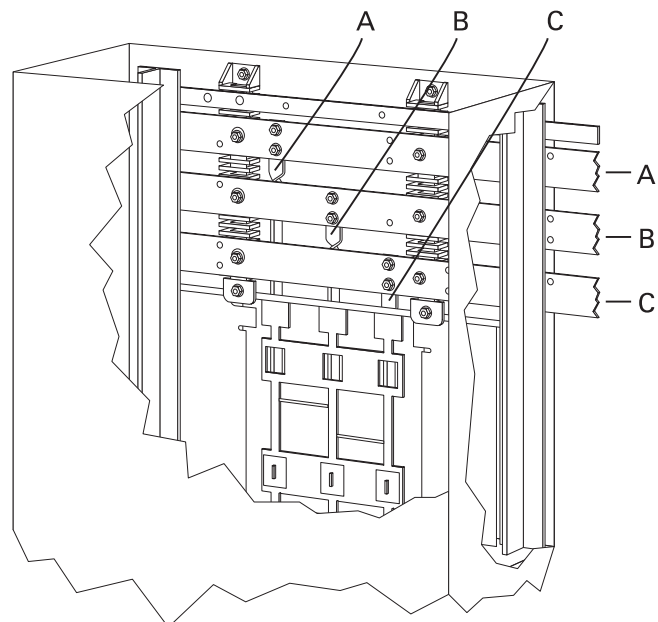


It should be noted that the NEMA phase arrangement illustrated in the previous drawing is viewed from the front. The vertical bus bars appear to be in reverse order when viewed from the rear. Some motor control centers can have devices installed on the front and rear of the motor control center.

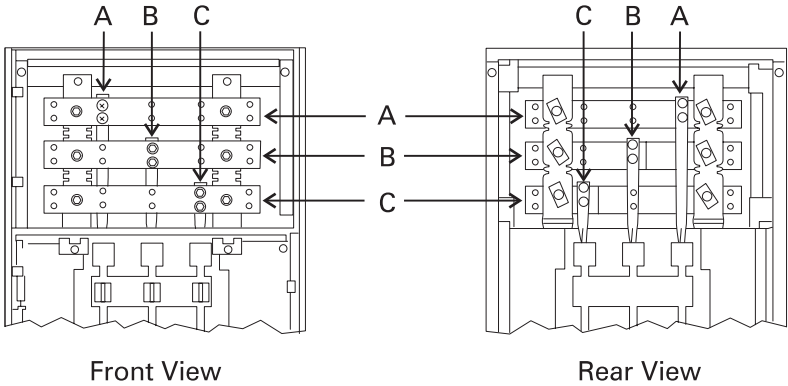


Shipping Splits

When a motor control center is made up of more than one vertical section, the sections are assembled together with a common top- and bottom-frame assembly. For shipping, this assembly can consist of a maximum of four 20" wide vertical sections (80" maximum). Several assemblies can be bolted and bussed together at the installation site to form a complete lineup. In the following illustration one vertical section has been moved to show the horizontal bus. In this case each horizontal bus bar is a single continuous piece that extends through all three sections.

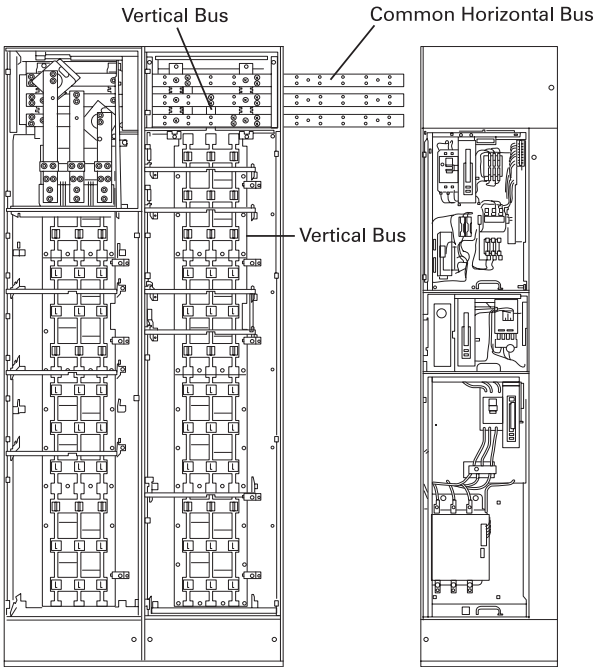


When there are more than four sections or the customer specifies a split between two vertical sections a splice kit between the horizontal bus bars can be installed.

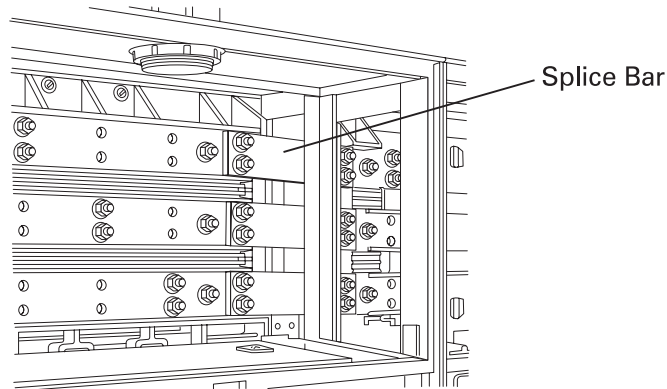

Combination Motor Control Units


Motor control centers are distinguished from other distribution devices, such as panelboards and switchboards, in that motor control centers principally contain combination motor control units. Panelboards and switchboards principally contain branch circuit-protection devices such as circuit breakers and fusible disconnects.

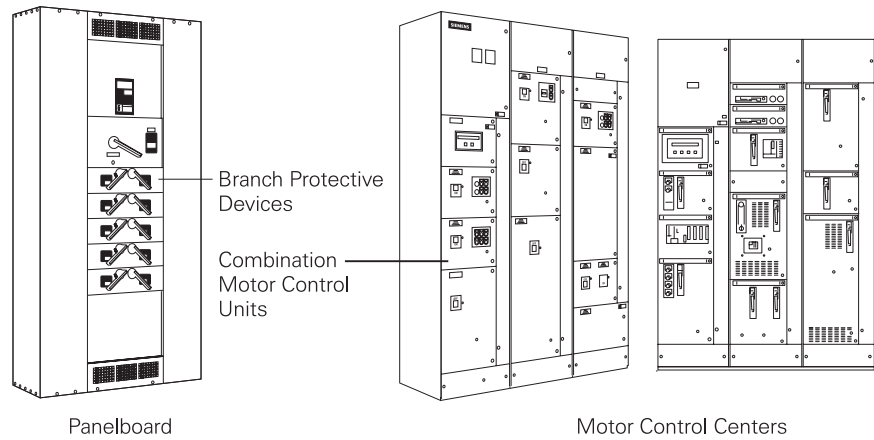

Underwriter's Laboratory

Underwriters Laboratory (UL) is a private company that is nationally recognized as an independent testing laboratory. UL tests products for safety. Products that pass UL tests can carry a UL label.

UL defines a motor control center similarly to NEMA. In addition, UL 845 discusses use of associated auxiliary devices and panelboards to be part of a motor control center. UL will allow use of branch circuit-protection units in a motor control center provided their use does not make up a major portion of the motor control center. It can be seen in the following illustration that a Siemens panelboard has been incorporated in a motor control center.

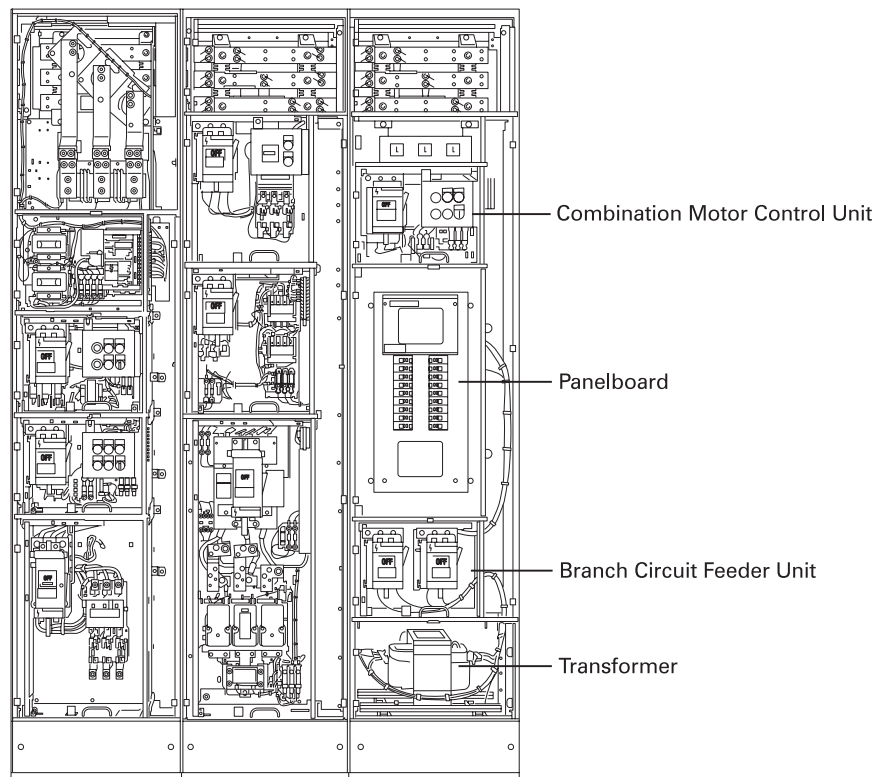


Combination Motor Control Units

Motor control centers principally contain combination motor control units. NEMA ICS-1-322 states that . . .


A combination motor control unit shall include externally operable circuit disconnecting means, branch-circuit overcurrent protection, and a magnetic motor controller with associated auxiliary devices when used. The disconnecting means and branch-circuit overcurrent protection shall consist of a fusible disconnecting device or circuit breaker. If the latter is used, it shall either be an inverse time (thermal-magnetic or dual magnetic) or an instantaneous magnetic type. The motor controller shall include motor and branch-circuit protection unless equivalent protection is otherwise provided.

A combination motor control unit takes all the elements required to control an AC motor and combines them into one unit. The combination motor control unit in the following example uses a molded case circuit breaker to provide circuit disconnecting means and branch-circuit overcurrent protection. The circuit breaker is opened and closed using the operating handle located on the front of the unit. The magnetic motor starter is used to start and stop an AC motor and provide overcurrent protection for the motor. Pilot devices, located on the door, serve to provide an operator means to start and stop the motor as well as provide visual indication of the motor's status.

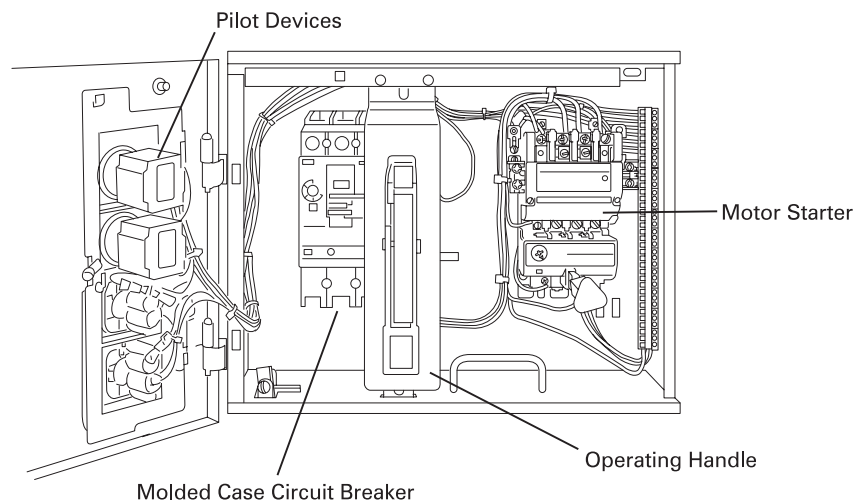


Differences in Units

Although the function of the combination motor control unit is the same for the System/89™ and the Model 95 Plus, there are some differences in the design of the units. For this reason it is important to note that combination motor control units designed for the System/89 motor control center are not interchangeable with combination motor control units designed for the Model 95 Plus.

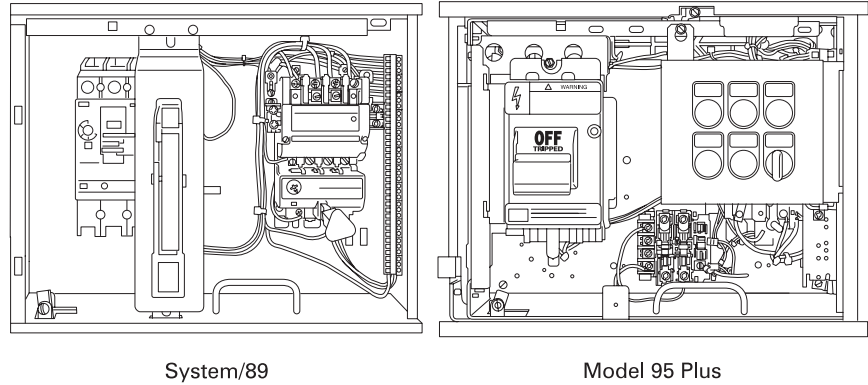


Vertical Space

Most vertical sections provide 72" of vertical space for the combination motor control units. As many sections as needed will be assembled together to contain all of the required combination motor control units and other equipment. Wireways run horizontally across the top and bottom of all of the sections. A vertical wireway is provided in each vertical section.

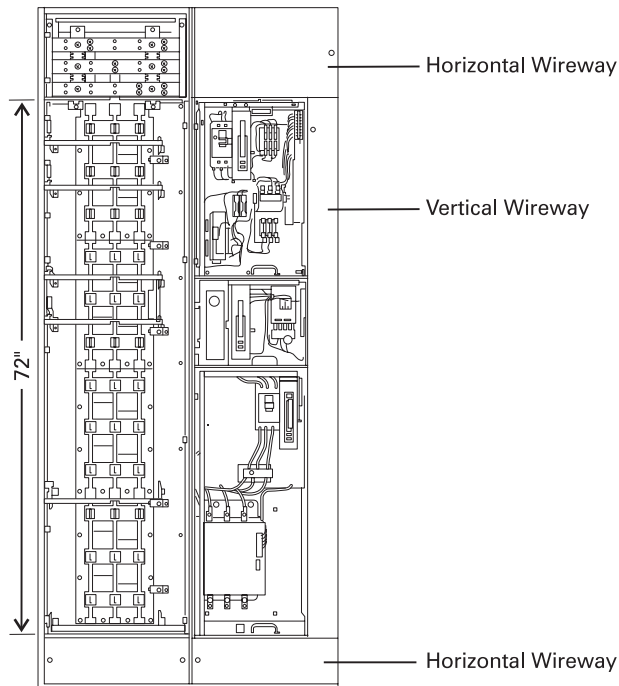


Dimensions

Combination motor control units are designed to fit into modular compartments. Typically, the minimum height of a combination motor control unit is 12", increasing in 6" increments (12", 18", 24", 30", up to 72") as needed. Six combination motor control units that are 12" high will fit in 72" of vertical space.

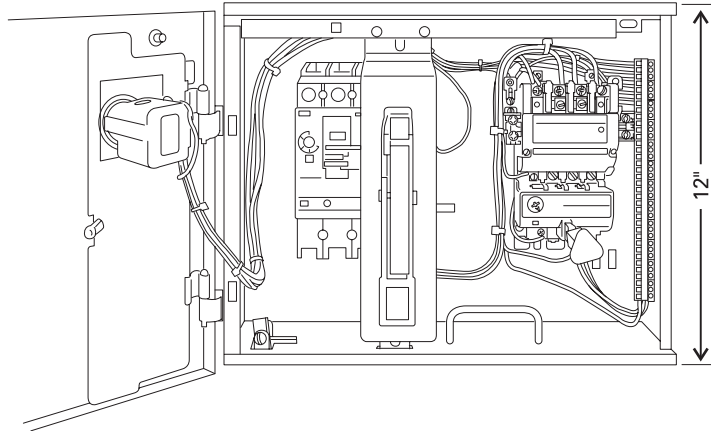


Installation and Removal

To simplify installation and removal combination motor control units are provided with self-aligning copper stabs on the back of the control unit. An optional ground bus stab is used when a vertical ground bus is supplied. A fixed mounting is used when the unit is physically too large for stabs or rated for greater than 250 amps.

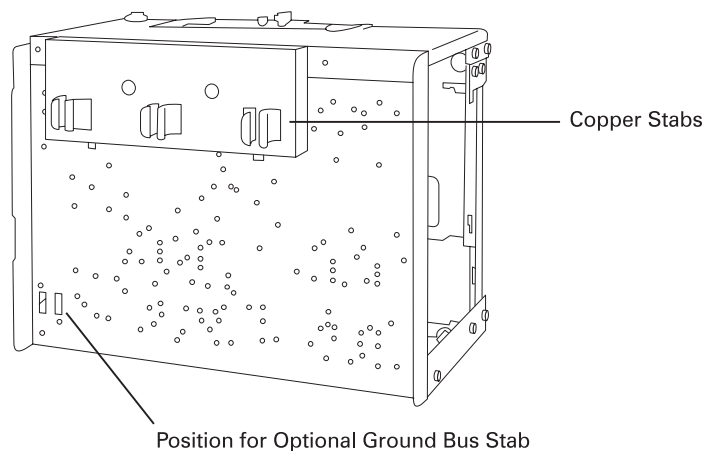


These stabs engage the vertical bus bars, making the electrical connection to the control unit. Siemens incorporates a flat vertical bus bar to ensure positive connection between the stab and the bus bar.




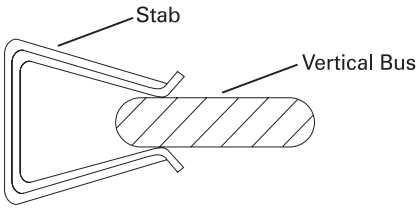


Unit Supports

Combination motor control units are supported in the motor control center on shelf brackets. The brackets can be easily moved to accommodate different size units. The brackets guide the combination motor control unit to assure positive engagement with the vertical bus.

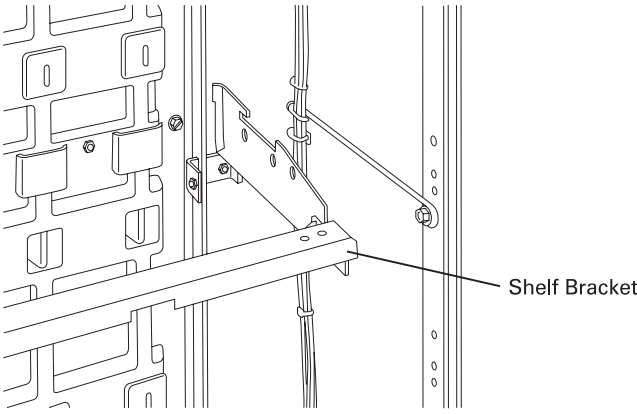


Review 3

1. Which of the following is not a part of the NEMA definition for motor control centers?
 - a. Floor-mounted assembly
 - b. Allowance for branch-circuit protection units
 - c. Common horizontal bus
 - d. Principally contains combination motor control units
2. The maximum shipping width of a motor control center is _____ inches.
3. Which of the following illustrates proper NEMA phase arrangement, as viewed from the front?
 - a. 
 - b. 
 - c. 
 - d. 

4. A distinguishing feature of motor control centers from panelboards is that motor control centers _____.
 - a. principally contain combination motor control units
 - b. principally contain branch-circuit protection devices
 - c. utilize both a horizontal and a vertical bus
 - d. connect to three-phase power
5. According to the NEMA definition, which of the following is not part of a combination motor control unit?
 - a. externally operable circuit disconnecting means
 - b. common horizontal bus
 - c. branch-circuit overcurrent protection
 - d. magnetic motor controller


Motor Starters

The motor starter is the heart of the combination motor control unit. Motor starters consist of a contactor and an overload relay. The contactor portion of a motor starter provides the means to remotely start and stop a motor. The overload relay protects the motor from overload conditions.

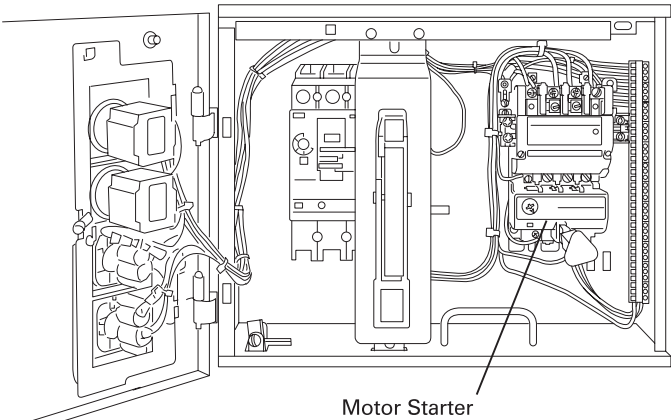


Overload Relay Trip Classes

Overload relays are rated by a trip class, which defines the length of time it will take for the relay to trip in an overload condition. The most common trip classes are Class 10, Class 20 and Class 30. Class 10, for example, has to trip the motor off line in 10 seconds or less at 600% of the full load amps. This is usually sufficient time for the motor to reach full speed. Many industrial loads, particularly high inertia loads, use Class 20.

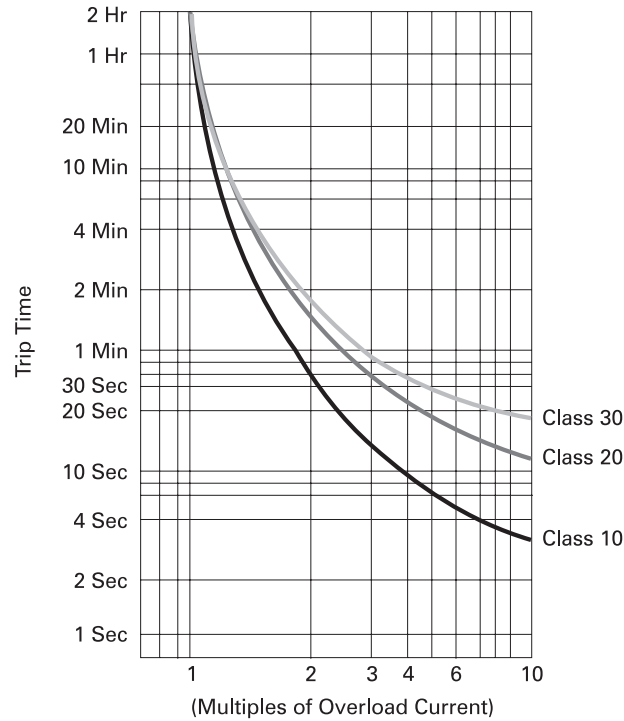


INNOVA PLUS

INNOVA PLUS™ is one type of starter which can be used in motor control centers. INNOVA PLUS starters are available with a Class 20 melting alloy type overload relay as standard. Class 10 or Class 20 ambient compensated or non-compensated bimetal overload relays are also available.

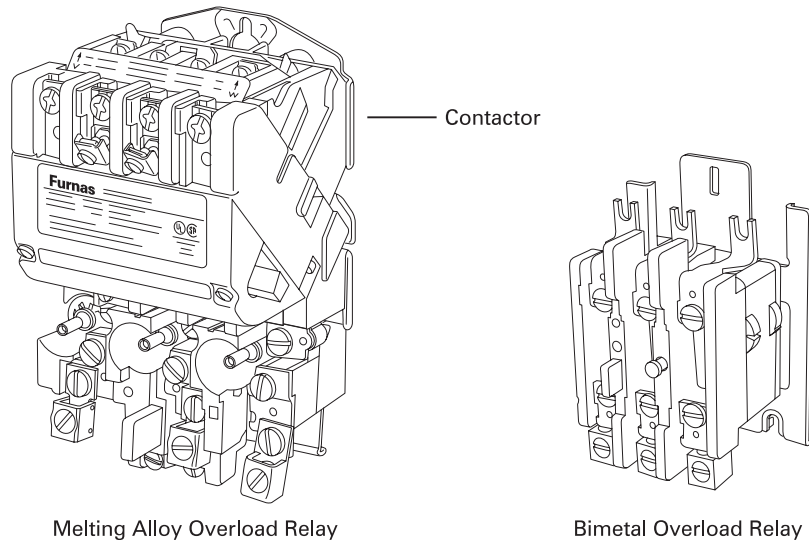


ESP100

The Furnas ESP100™ starters use the same contactor as the INNOVA PLUS™ starters. The ESP100 starters are supplied with a Class 10, 20, or 30 solid-state overload relay. The ESP100 also protects the motor against phase loss. The ESP100 trips within three seconds of loss of one of the power supply phases.

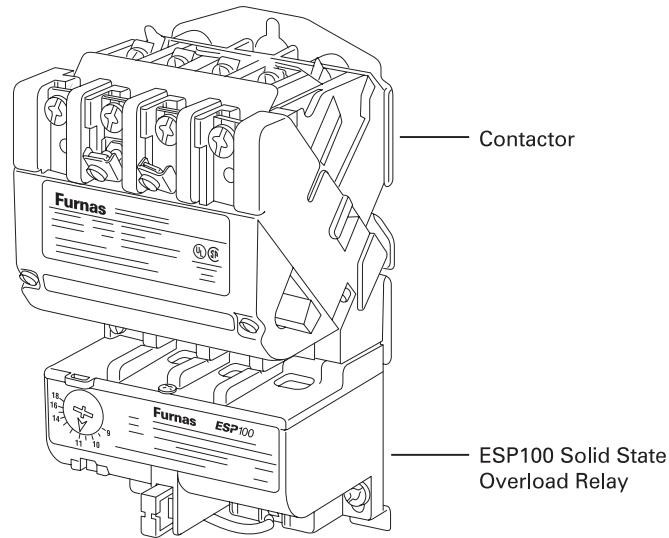


A single ESP100 overload relay replaces at least six size ranges of heaters. Instead of installing heaters the full load amperes (FLA) of the motor is set with a dial. The ESP100 overload relay protects 3Ø motors with FLA of ¼ ampere through 540 amperes. From ¼ ampere to 10 amperes the overload has a 4:1 FLA range; i.e. 2½ - 10 amperes. Above 10 amperes the range is 2:1. The ESP100 overload relay illustrated below, for example, is adjustable from 9 to 18 amperes.

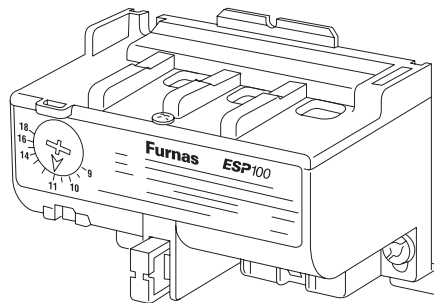

SAMMS

Siemens contactors can also be configured for use with the Siemens Advanced Motor Master System (SAMMS™). The SAMMS unit is a UL-recognized microprocessor-based motor control and protection device designed specifically for use in motor control centers. SAMMS provides microprocessor-based control and protection for all NEMA-rated low-voltage motors. Full communication options are available with SAMMS.

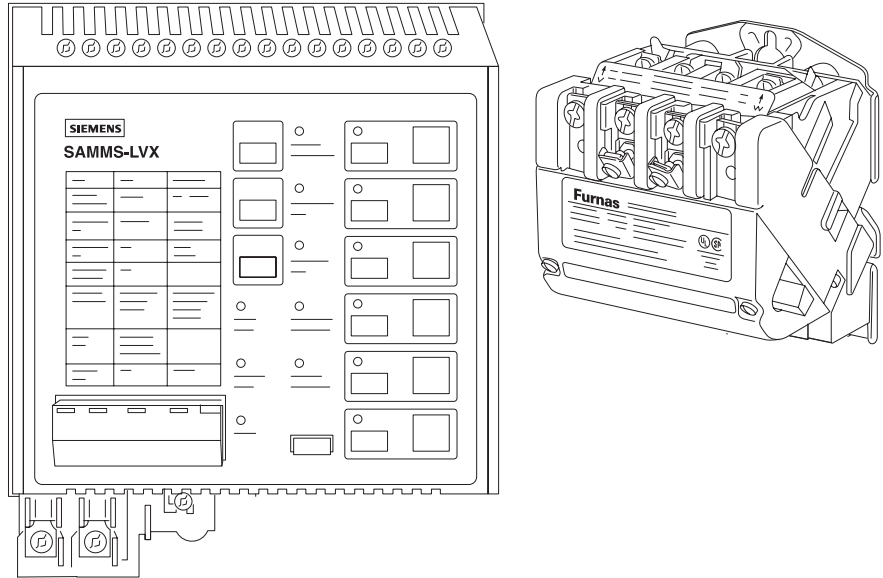

Starter Ratings

Starter contactors are rated according to size and type of load they handle. NEMA and the International Electrotechnical Commission (IEC) rate contactors and motor starters. NEMA is primarily associated with equipment used in North America. IEC, on the other hand, is associated with equipment sold in many countries including the United States.

There are differences between NEMA- and IEC-rated devices. Each organization has its own procedures and standards. NEMA ratings are maximum-horsepower ratings. NEMA specifies sizes from size 00 to size 9, which cover the horsepower range from 2 HP to 1,600 HP at 460 volts.

Size of Controller	Horsepower at 460 V/60 Hz
00	2
0	5
1	10
2	25
3	50
4	100
5	200
6	400
7	600
8	900
9	1600

IEC ratings are maximum operational current as specified by the International Electrotechnical Commission. IEC does not specify sizes. The buyer needs to make clear which standards he expects to be met.

Types of Starters


Starters can be configured to perform several different tasks. The following types of combination starters can be found in Siemens motor control centers:

FVNR	Full Voltage Non-Reversing
FVR	Full Voltage Reversing
2S1W	Two Speed One Winding Reconnectable Consequent Pole Unit
2S2W	Two Speed Two Winding
PW	Full Voltage Part Winding
RVAT	Reduced Voltage Auto-Transformer (Closed Transition)
3YD	Wye Delta (Open or Closed Transition)

Pilot Devices


A number of pilot devices can be used on Siemens motor control centers. Pilot devices include pushbuttons, selector switches, and pilot lights.

System/89™ motor control centers typically use Class 52 30 mm pilot devices. As a standard up to four pilot devices can be used per combination motor control unit. On the Model 95 Plus the 22 mm pilot devices are used. There is room to mount up to six pilot devices.

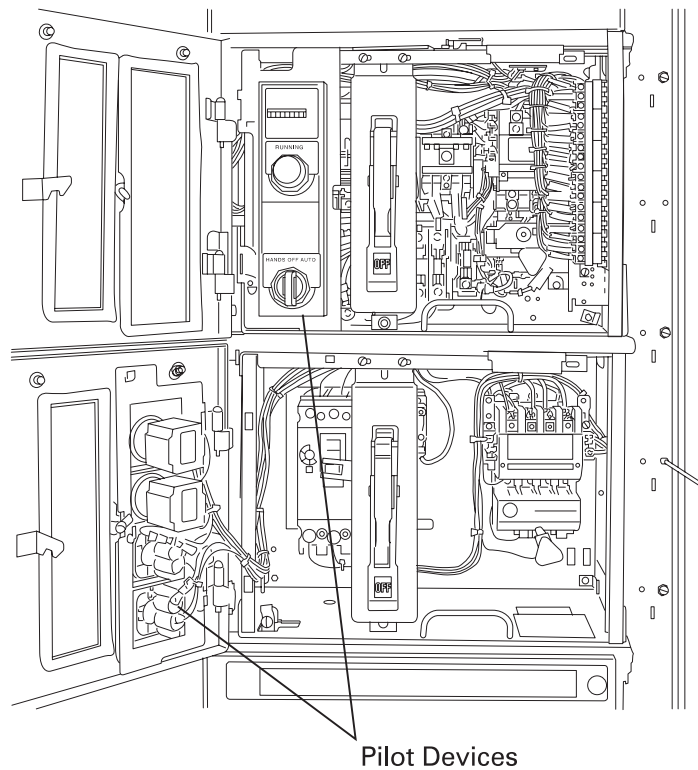


Pushbuttons

A pushbutton is a control device used to manually open and close a set of contacts. Pushbuttons are available in a flush mount, extended mount, with a mushroom head, illuminated, or non-illuminated. Pushbuttons come with either normally open, normally closed, or a combination contact block.




Siemens
22 mm Diameter
Pushbutton




Siemens Furnas Control
30 mm Class 52
Pushbutton

Selector Switches

Selector switches are also used to manually open and close contacts. Selector switches can be maintained, spring return, or key operated. Selector switches are available in 2-, 3-, and 4-position types.




Siemens
22 mm Diameter
Selector Switch




Siemens Furnas Control
30 mm Class 52
Selector Switch

Pilot Lights

Pilot lights provide visual information of the circuit's operating condition. Pilot lights are normally used for ON/OFF indication, caution, changing conditions, and alarm signaling. Pilot lights come with a color lens, such as red, green, amber, blue, white, or clear.



Siemens
22 mm Diameter
Pilot Light




Furnas
30 mm Class 52
Pilot Light


Circuit Breakers

Circuit Breakers

Circuit breakers are typically used as disconnect devices in combination motor control units. Circuit breakers provide a manual means of energizing and de-energizing a circuit. In addition, circuit breakers provide automatic overcurrent protection of a circuit.

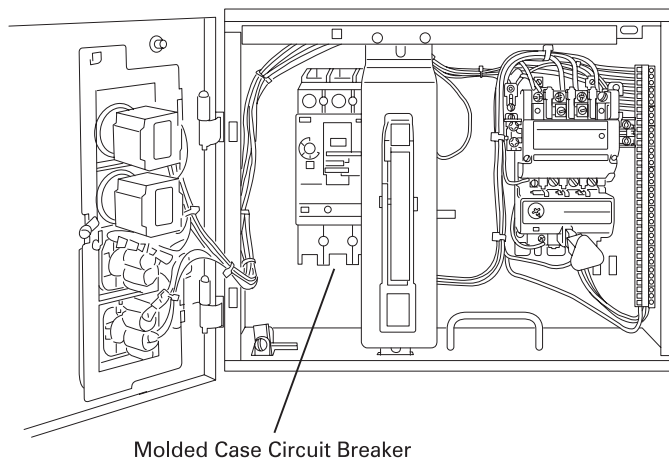

Siemens Sentron™ circuit breakers are available with ampere ratings up to 2000 amps. The Sentron series is also available in a digital version, referred to as Sensitrip III. Sensitrip III circuit breakers utilize a microcomputer which makes it possible to customize overcurrent protection which is matched exactly to the loads of an electrical system.

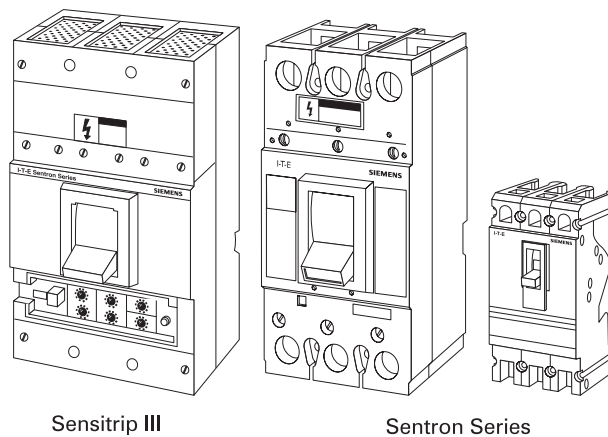


Circuit Breaker Ratings

There are two types of circuit breakers that are typically used in motor control centers. Thermal-magnetic circuit breakers have both overload and instantaneous trip features. When an overload condition exists, the excess current generates heat, which is detected in the circuit breaker. After a short period of time, depending on the rating of the breaker and the amount of overload, the breaker will trip, disconnecting the load from the voltage source. If a short circuit occurs, the breaker responds instantaneously to the fault current and disconnects the circuit. This type of circuit breaker is used in applications where a motor starter is not used, such as a main disconnect for the MCC or a feeder tap unit. Thermal-magnetic circuit breakers are not used in conjunction with a motor starter.

Instantaneous trip-only circuit breakers are also referred to as magnetic only or Type ETI circuit breakers. Type ETI circuit breakers provide short circuit protection, but they do not provide overload protection. Type ETI circuit breakers are commonly used in combination motor control units where a motor starter, such as the Furnas ESP100, provides overload protection. ETI trip ranges are selected to meet maximum settings per *NEC*[®] table 430-152 and exception C of Article 430-52. The instantaneous trip-only circuit breaker is factory set at the LOW position. In accordance with the *National Electrical Code*[®], the setting on an instantaneous trip circuit breaker may be increased over 800%, but cannot be increased over 1300% of full load amps.


Other Types of Units in MCCs

Siemens motor control centers may include solid-state motor control devices, such as reduced-voltage soft-start controllers, variable frequency drives, and programmable logic controllers (PLCs). In addition, power meters can be used to measure real-time RMS values of phase currents, phase and line voltages, power usage, power factor, KW, frequency, and peak demand.

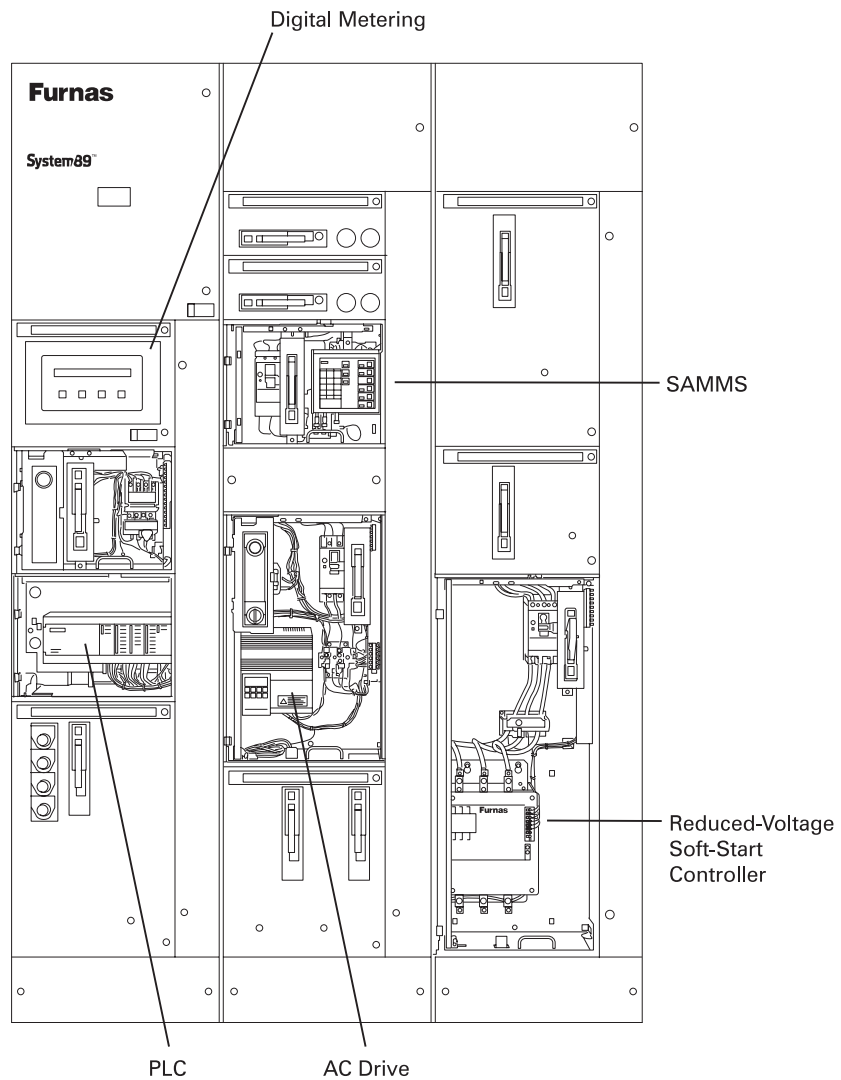


Reduced-Voltage Soft-Start Controllers

Reduced-voltage soft-start motor-starting controls, such as the Furnas Nordic reduced-voltage controllers, provides a smooth start while minimizing the high starting current and torque associated with across-the-line motor starting. Nordic controllers are available in sizes up to 800 HP at 480 or 600 volts.

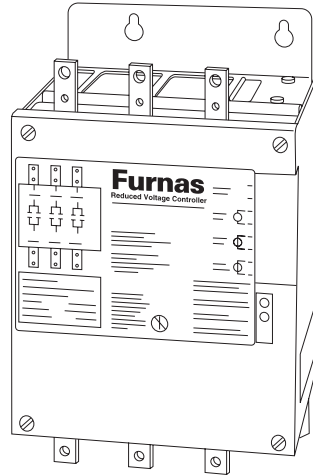


Variable Frequency Drives

Variable frequency drives are also referred to as AC drives. A typical AC drive receives 480 VAC, three-phase, 60 Hz input power which is used to start and stop a motor and control the operation of the motor throughout the speed range. A few features of Siemens AC drives include serial communication, DC injection braking, flux current control, vector control, pulsed resistor braking, and drive and motor protection. Siemens AC drives up to 250 HP at 480 VAC are available in MCCs.

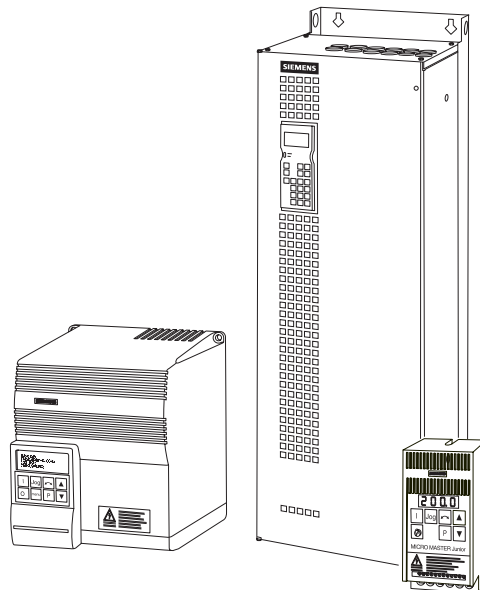


PLCs

PLCs consist of input modules or points, a central processing unit (CPU), and output modules or points. An input to a PLC may come from a variety of digital or analog signals from various field devices. The PLC converts the input signal into a logic signal that can be used by the CPU. Output modules convert control signals from the CPU into a digital or analog signal that can be used to control various field devices, such as a motor starter, an AC drive, or a reduced-voltage soft-start starter.

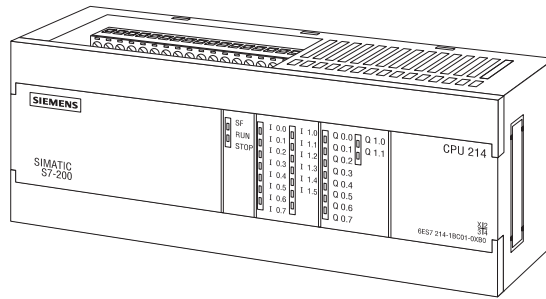


Digital Metering

Digital metering provides a highly accurate measure of current and power in industrial applications. Meters, such as the Siemens 4720, can read over 300 measurements and have the communication capabilities through the Siemens ACCESS™ system.

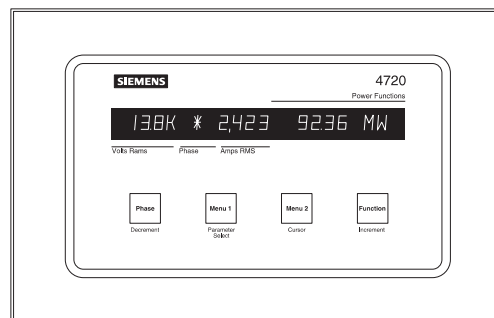

Other Units

There are other units that end up in MCCs such as relay panels, panelboards, and feeder-tap units. A feeder-tap unit, such as the one shown in the following illustration, is typically used to supply power to non-motor loads located downstream of the motor control center.

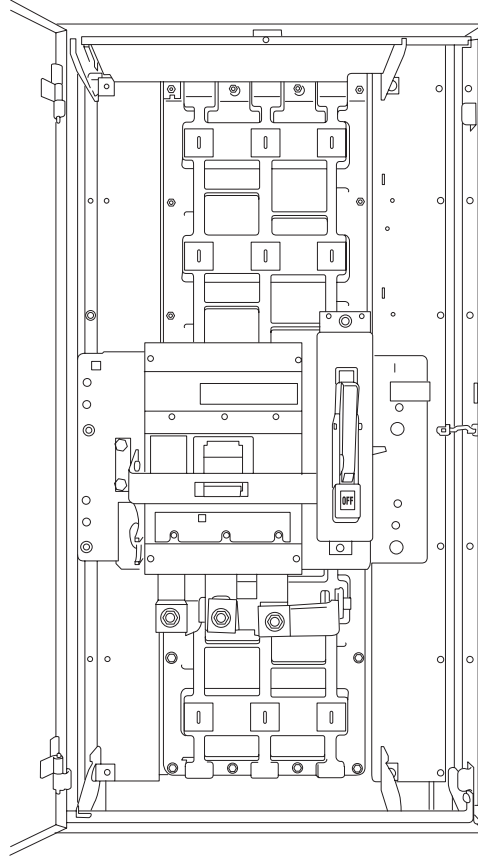

UL Marks

A motor control center has two UL marks. One is for the structure and bus, and one for each control unit. Some MCCs may contain special sections or units that have not been UL tested and therefore may not be able to carry the UL mark. Some municipalities may not allow devices that do not carry the UL mark.

Review 4


1. Class _____ provides the highest level of overload protection.
2. The ESP100 trips within _____ seconds of loss of one of the power-supply phases.
3. A size 5 controller is rated for _____ HP.
4. Which of the following devices can be used in a Siemens motor control center?
 - a. reduced-voltage starter
 - b. variable frequency drive
 - c. PLC
 - d. SAMMS
 - e. digital metering
 - f. all of the above
5. _____ is a Siemens tradename for a reduced-voltage soft-start controller.

MCC Ratings

In addition to the various ratings of individual components used in motor control centers, the overall ratings of the motor control center must also be considered.


Voltage Rating

Motor control centers are rated for 600 volts. This is the maximum voltage that can be applied to a motor control center. A motor control center can be connected to a lower voltage. A motor control center, for example, might be connected to a three-phase, 480 VAC power supply.

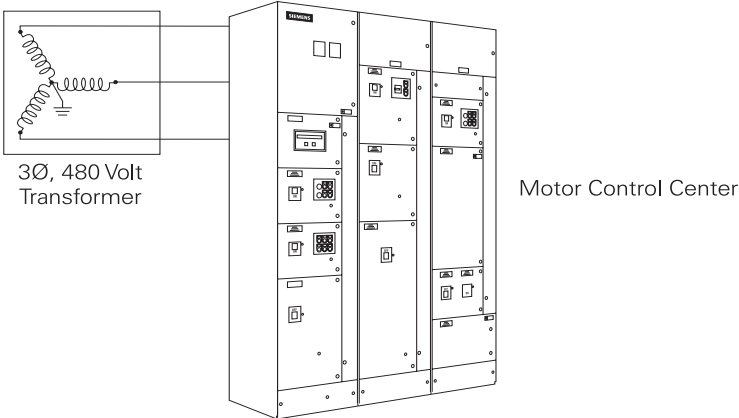


Horizontal Bus Current Rating

The horizontal bus on Siemens motor control centers are made of tin or optional silver plated copper. They are available with 600A, 800A, 1200A, 1600A, and 2000A current ratings.

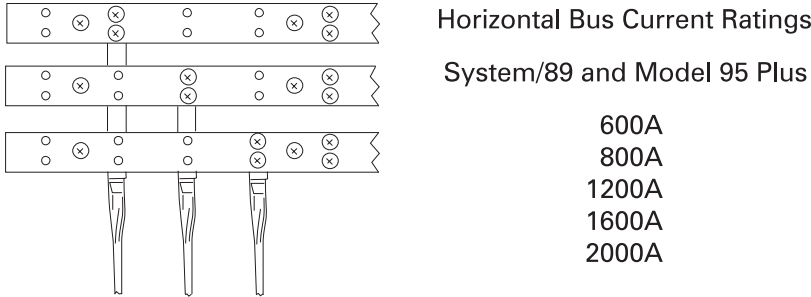

Vertical Bus

The vertical bus on the System/89 and Model 95 Plus motor control centers are available with 300A and 600A ratings.

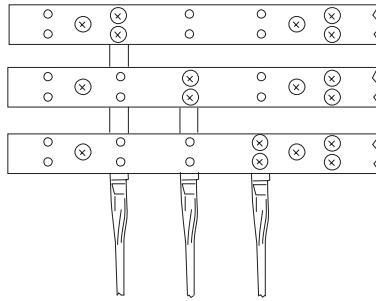

Vertical Bus Current Ratings


System/89 and Model 95 Plus

300A

600A

Bus Bracing

Motor control centers must be capable of withstanding the largest potential short-circuit current which can occur in the selected application. The amount of short-circuit current available depends on the amount of power available to a facility. Short-circuit current can be thousands of times higher than normal current. Bus bars must be braced to withstand this potential current. Siemens bus bars are braced for 42,000 AIC (ampere interrupting capacity) with optional bracing available to 100,000 AIC.

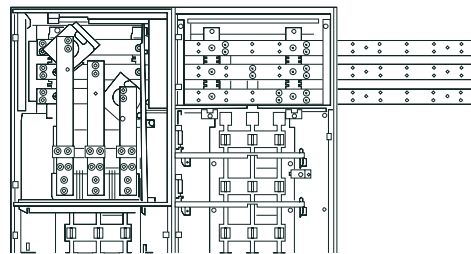

(System/89 Shown)

Bus Bracing


System/89	Model 95 Plus
42KAIC	42KAIC
65KAIC	65KAIC
85KAIC	100KAIC
100KAIC	

Temperature Rise

The bus bars are the major current carrying component of the motor control center. Before a motor control center is operated, bus bars are at the temperature of the surrounding air. This is known as ambient temperature. Temperature rises in the motor control center bus bars during operation. The combination of ambient temperature and allowed temperature rise equals the maximum temperature of the bus bars.

NEMA and UL both have standards concerning the maximum temperature rise of bus bars used in motor control centers. NEMA limits temperature rise to 65°C based on an ambient temperature of 40°C (104°F), for a maximum operating temperature of 105°C. UL limits temperature rise to 50°C based on an ambient temperature of 40°C (104°F), for a maximum operating temperature of 90°C. Electrical equipment bearing a UL mark must meet or exceed this standard.

Siemens motor control centers meet or exceed NEMA and UL standards. Bus bars in Siemens motor control centers are tested with a maximum temperature rise of 50°C over 40°C (104°F) ambient.

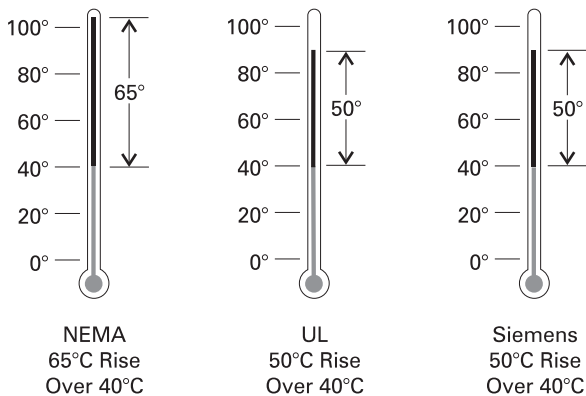


Enclosures

NEMA defines an enclosure as *a surrounding case constructed to provide a degree of protection to personnel against incidental contact with the enclosed equipment and to provide a degree of protection to the enclosed equipment against specified environmental conditions* (NEMA Standard 250 - section 2, definitions).

The following brief descriptions cover enclosures available for Siemens motor control centers.

Type 1 Enclosure

Type 1 enclosures are intended for indoor use primarily to provide protection against limited amounts of falling dirt and contact with the enclosed equipment in locations where unusual service conditions do not exist.

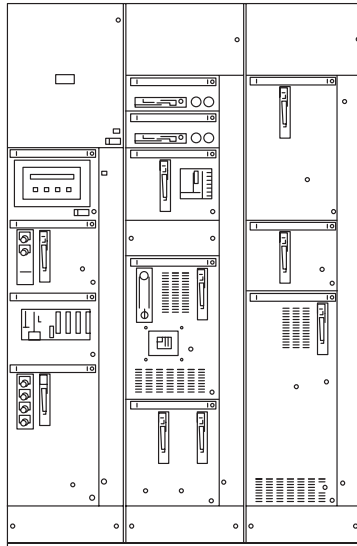

Type 1 Gasket Front

Type 1 gasketed front, general purpose, indoor enclosure has the same use as Type 1 except the front of the enclosure is gasketed. In addition the following parts are gasketed:

- Unit separator angles
- Right-hand side of front of units
- Bottom horizontal cross ties
- Lip on top plate
- Pilot-device panel
- Handle mechanism
- Bottom horizontal wireway cover plate
- Side holes are plugged

Type 2, Drip-Proof

Type 2, drip-proof is an indoor enclosure intended to protect equipment from falling noncorrosive liquids and dirt. The enclosure prevents the entrance of dripping liquid at a higher level than the lowest live part within the enclosure. This design is a Type 1 gasketed front, or Type 12, with a drip shield mounted on top of the enclosure.

Type 12 Enclosure

Type 12 enclosures are intended for indoor use primarily to provide a degree of protection against circulating dust, falling dirt, and dripping noncorrosive liquids. They are not intended to provide protection against conditions such as internal condensation.

The Type 12 will provide a greater degree of protection than a Type 1 gasketed enclosure. The following additional parts are gasketed:


- Hinged side of doors
- Top plates
- Wireway end-covers
- Rear plates

There is no gap between sections, allowing for much greater dust resistance. In addition, interconnection holes in the side sheet assemblies are sealed. Bottom plates are included.

Type 3R Enclosure

Type 3R enclosures are intended for outdoor use primarily to provide a degree of protection against falling rain and sleet and protection from contact with the enclosed equipment. They are not dust, snow, or sleet (ice) proof. They will prevent entrance of rain at a level higher than the lowest live part. The enclosure has provisions for locking and drainage.

The enclosure entirely surrounds the motor control center for outdoor operation. The Type 3R enclosure is designed to accommodate bottom cable entry and exit only. The 3R enclosure is not a walk-in type design.

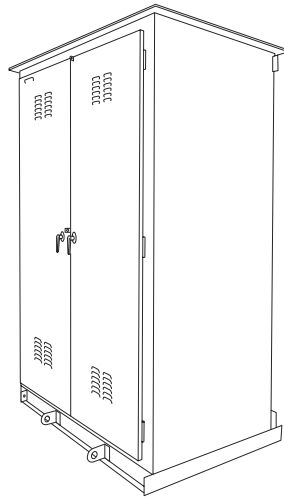

NEMA and IEC

The International Electrotechnical Commission (IEC) is another organization that defines the degree of protection provided by enclosures. NEMA is primarily associated with equipment used in North America. IEC is associated with equipment sold in many countries including the United States.

The IEC designation consists of the letters IP followed by two numbers. The first number indicates the degree of protection provided by the enclosure with respect to persons and solid objects entering the enclosure. The second number indicates the degree of protection against the ingress of water. The following chart provides an equivalent conversion between NEMA and IEC designations.

NEMA	IEC
1	IP10
2	IP11
3R	IP14
12	IP52

Classification and Types of Wiring


NEMA has established two classification standards (Class I and Class II) and three types of wiring (A, B, and C) used in the construction of motor control centers. These are specified by the customer.

Class I

Class I consists of a grouping of combination motor control units in which each starter and motor operates independently of the other starters. The factory connects the combination motor control units to the vertical bus but does not provide interconnecting wiring between combination motor control units, different vertical units, or remotely connected devices. Diagrams of the individual units only are supplied.

Class I, Type A Wiring

Type A wiring is only available on Class I motor control centers. The motor control center manufacturer connects the combination motor control unit to the vertical bus via the stabs on the back of the unit. Power is applied to the circuit breaker from the vertical bus. The circuit breaker is factory wired to the motor starter. The customer connects the motor leads and control wiring to the motor starter. There is no interconnecting wiring between combination motor control units.

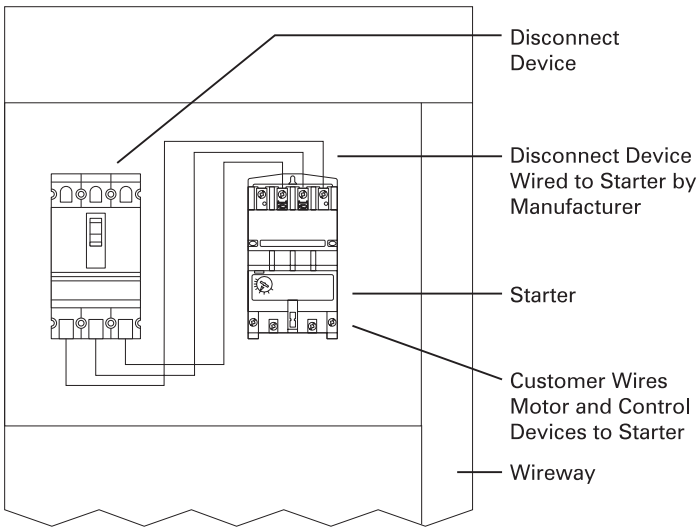


Vertical Section


Class I, Type B Wiring

Typically pilot devices, such as indicator lights, pushbuttons, and selector switches, are used with Class I, Type B wiring. Type B wiring is divided into two designations: B-d (-d for connection of load wires directly on starter or contactor terminals) and B-t (-t for connection of load wires to unit mounted load terminal blocks).

When Type B-d wiring is specified, terminal blocks are furnished near the wireway for control circuit connections. Motor leads are connected directly to the overload relay terminals.

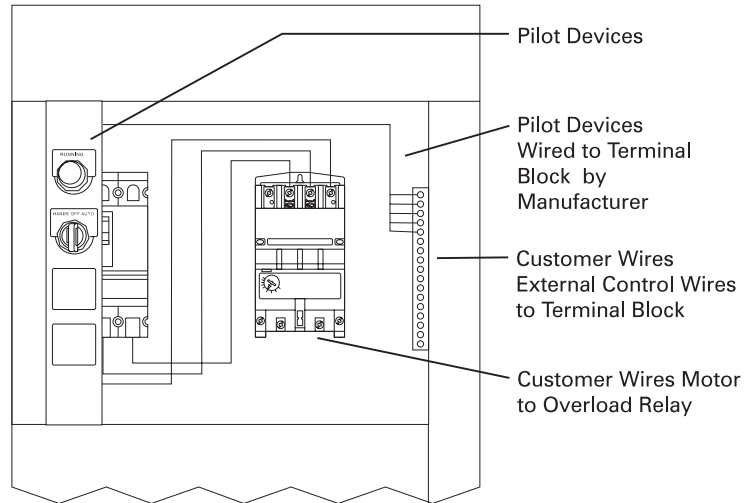


When Type B-t wiring is specified, terminal blocks are furnished near the wireway for control circuit connections and for motor starter leads. Type B-t wiring can be used on starters up to size 3.

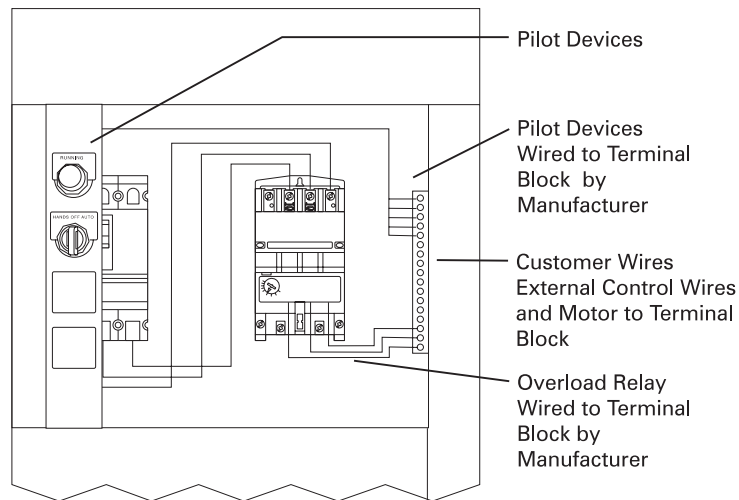

Class I, Type C Wiring

With Type C wiring, a master terminal block is provided in either the top or bottom horizontal wiring gutter. The manufacturer of the motor control center brings the control wires from each control unit to the master terminal block. The installer is then able to make his wiring connections at the master terminal block. With Type C wiring, load wiring for combination motor control units smaller than size 3 (50 HP) are connected to the master terminal block. Load wiring for combination motor control units larger than size 3 are connected directly to unit device terminals..

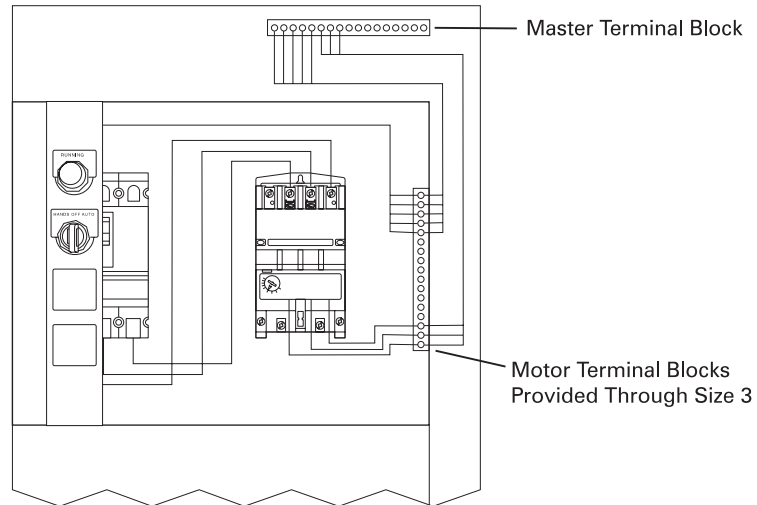


Class II

Class II consists of a grouping of combination motor control units with interwiring and interlocking between the starters to form a complete control system. Wiring diagrams, including the interwiring, is furnished. Class II is generally specified when a group of motors requires sequencing, interlocking, or interconnecting.


Class II, Type B

Class II, Type B wiring is similar to Class I, Type B wiring. Terminal blocks are furnished near the wireway. In addition, Class II, Type B wiring includes interconnecting wiring between motor starters.

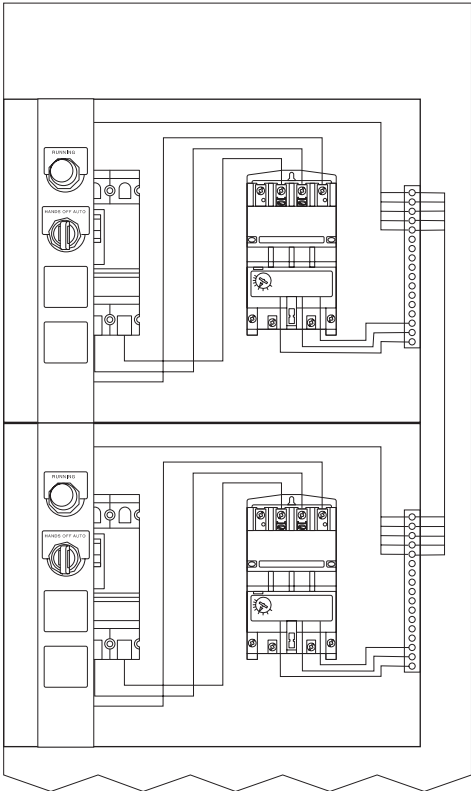

Class II, Type C

Class II, Type C wiring is similar to Class I, Type C wiring. In addition, Class II, Type C wiring includes interconnecting wiring between motor starters and vertical sections.

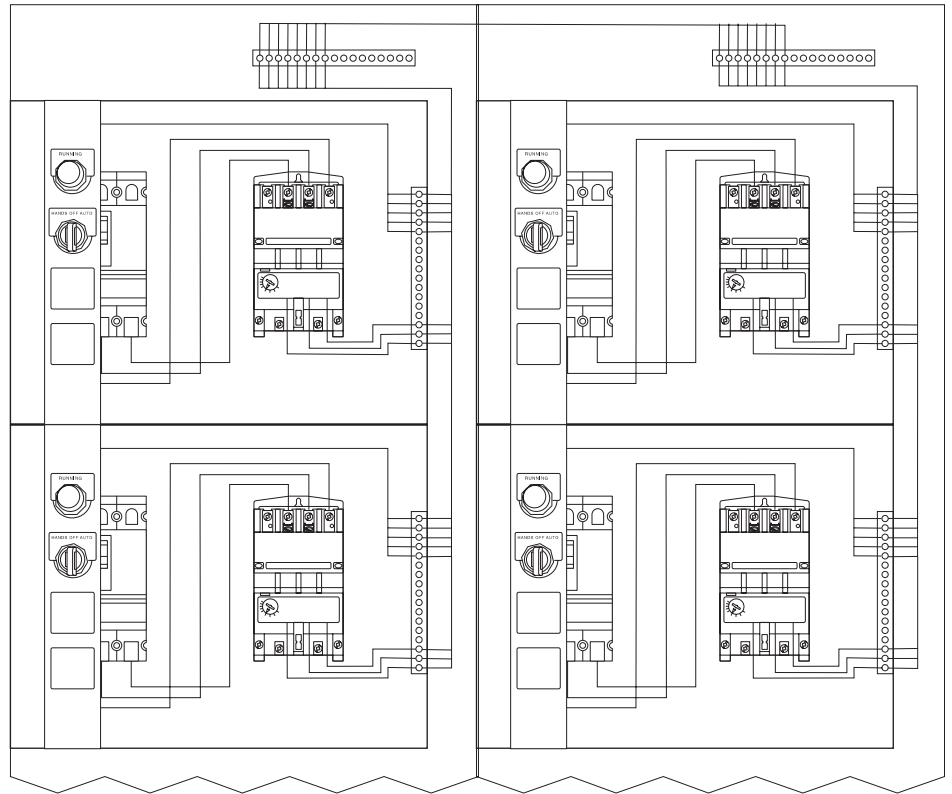

Reference Chart

The following chart provides a handy reference when determining the class and type of wiring used in motor control centers.

Description	Class I Types				Class II Types		
	A	B-d	B-t	C	B-d	B-t	C
Terminals Required For all Control Connections For Starter Load Connections Sizes 1 through 3 ^①		✓	✓	✓	✓	✓	✓
Terminals Mounted On Control Unit In Master Terminal Compartment ^②		✓	✓	✓	✓	✓	✓
Interwiring Between Units in the same MCC					✓	✓	✓
Diagram Connection for each Starter or Control Unit Elementary and Interconnection of Complete MCC	✓	✓	✓	✓	✓	✓	✓
Other Drawings Overall Dimensions of MCC Location of Terminals in Master Terminal Compartment	✓	✓	✓	✓	✓	✓	✓ ^③

① No load terminals furnished for starters sizes 3½ through 6, main or branch circuit breaker or fusible switches, distribution transformers or lighting panelboards.

② Located at top or bottom of each section and wired to the various parts.


③ Included on motor control center interconnection diagram.

Cable Entry

There are several ways incoming power can be terminated in a motor control center. Cable can be routed directly to the incoming power lugs, to main breakers or disconnects, or to a terminal block in a vertical section. In addition, incoming power cables can enter and exit the motor control center from the top or bottom depending on the application.


Main Lugs

When using main lugs the amount of vertical space required varies with the amperage rating. When the main lugs are located on the top, as in the following illustration, the vertical space is taken at the top. A motor control center can also have the lugs located at the bottom of the MCC. In the following illustration, for example, main lugs rated for 600 amps are located on the top of the MCC. In this example 24" of vertical space is required.

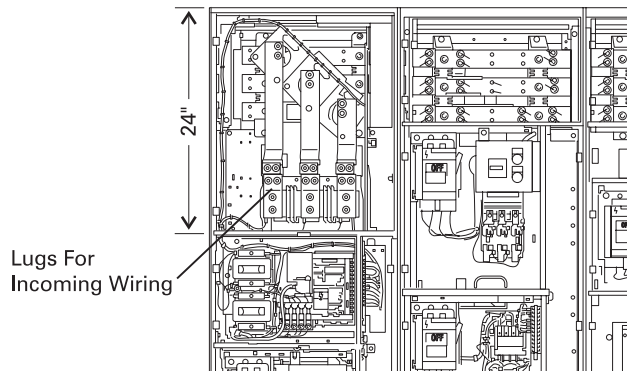


**Main Lugs on Top,
Top Entry**

In the arrangement illustrated below incoming power cables enter through the top of a vertical section and are connected to main lugs.

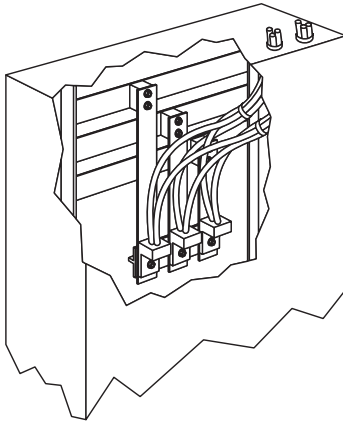


**Main Lugs on Top,
Bottom Entry**

Incoming cables can also enter from the bottom and connect to main lugs located in the top section.

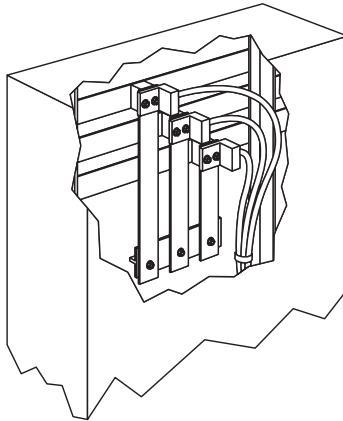


**Main Lugs on Bottom,
Bottom Cable Entry**

Lugs can also be supplied on the bottom of the vertical bus for bottom cable entry.

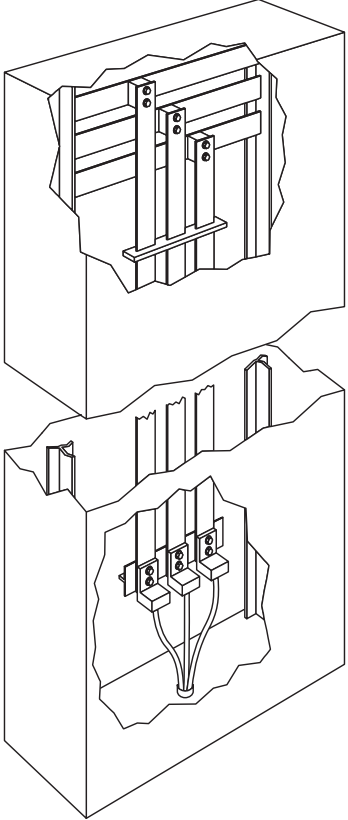


Disconnect Device


When a main disconnect device, such as a circuit breaker or fusible disconnect, is used, the disconnect is mounted in its own unit. The amount of space required depends on the disconnect used. The space can vary from 12" to 72".

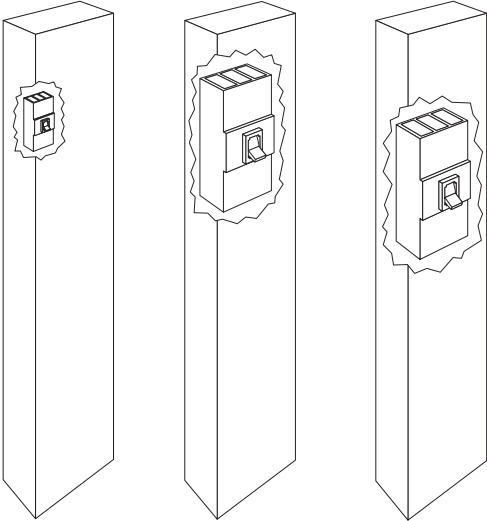

In the following illustration a main circuit breaker is used. Cable entry can be from the top or bottom of the vertical section.

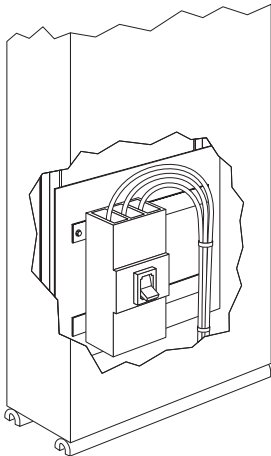

Bottom Entry

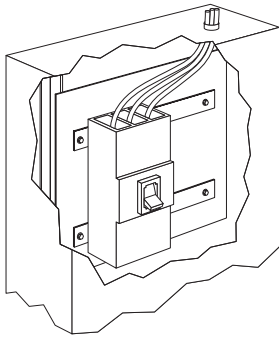


Top Entry


Review 5

1. The maximum current rating for a horizontal bus on Siemens motor control center is _____ amps.
2. The maximum bus bracing available for a Siemens motor control center is _____ AIC.
3. The IEC equivalent of a NEMA Type 3R enclosure is _____ .
4. Identify the following types of Class I wiring:


a. _____

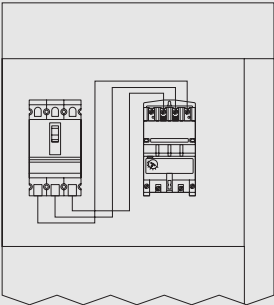


b. _____

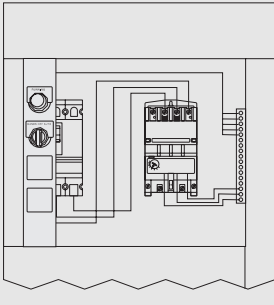

c. _____




d. _____



System/89


System/89™ is one of the motor control centers that Siemens manufactures. Several mechanisms and features have been designed into System/89. Many of these features will be discussed in this section.

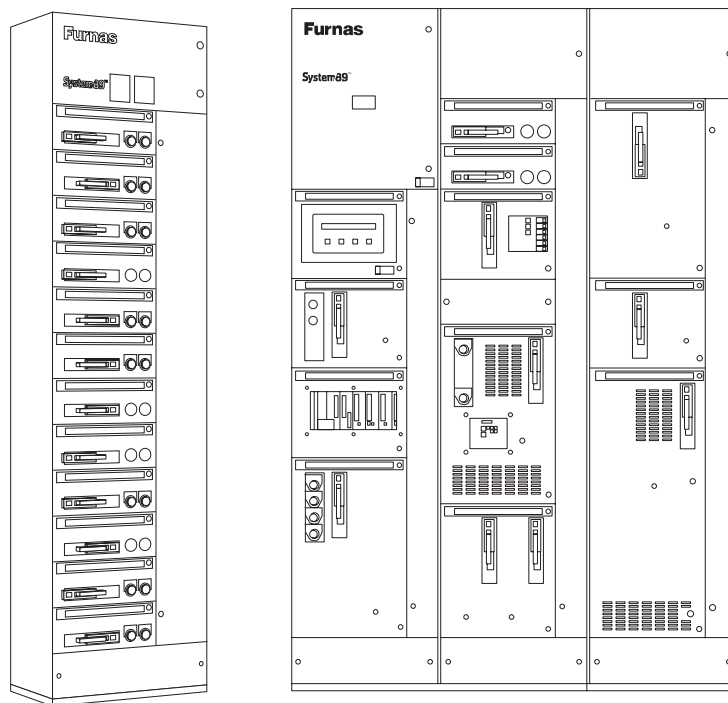

Dimensions


The nominal height of the System/89 is 90" high. The overall height is 91 1/8" including a standard 1 1/8" base channel. There are 72" of vertical space available for combination motor control units, with 12" at the top and 6" at the bottom for wiring. The horizontal power bus is located in the 12" of top space making it easier to service. Each vertical unit will hold up to six 12" units (6 x 12 = 72). An optional pull box (top hat) can be supplied when extra wire-bending space is required. Pull boxes can be 12", 18", or 24" high.

Vertical structures are 20" wide. A 30" wide unit is available for special units, such as large AC drives or transformers that require more space. The vertical wireway is 4" wide on 20" wide sections. An optional 8"-wide wireway is available on 20" wide sections. Vertical units can be 15" or 20" deep.

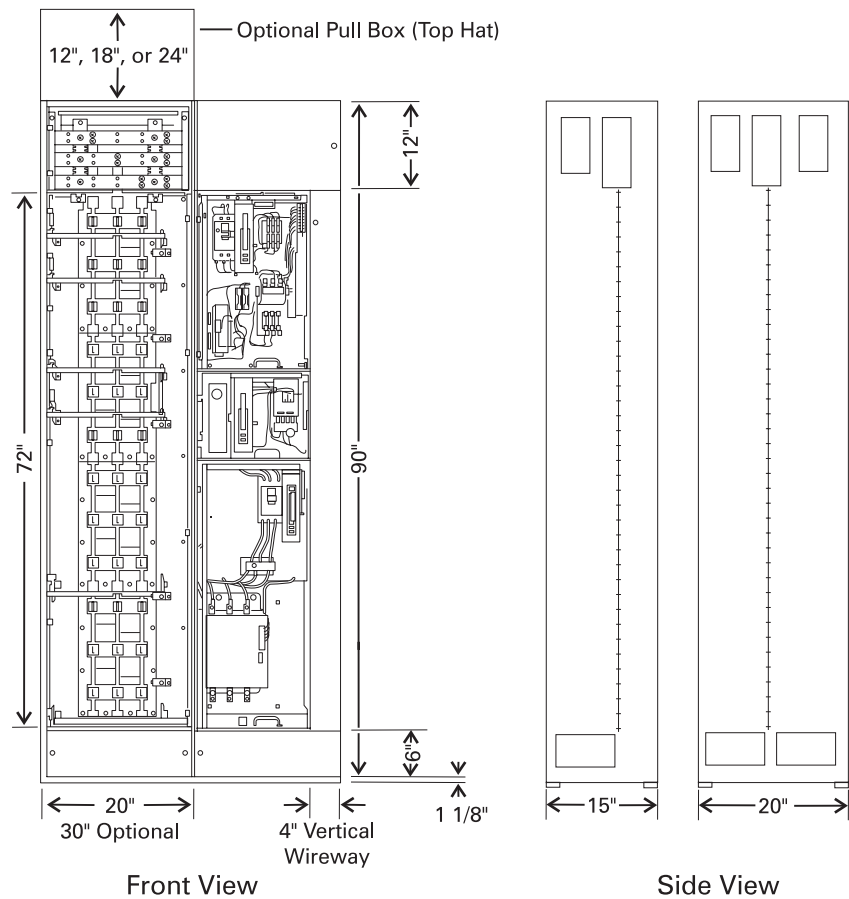


Back-to-Back Mounting


A feature of the System/89 is the ability to mount combination motor control units back to back. This permits mounting 12 combination motor control units in 72" of vertical space. System/89 vertical units designed for back-to-back mounting are 21" deep.

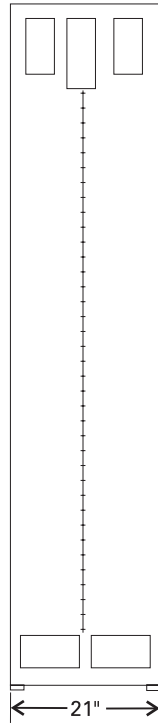

Back-to-back combination motor control units use the same stab-on connection as front mounted units.

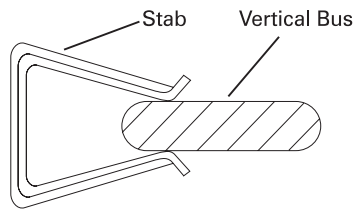


Front Mounted Unit Only

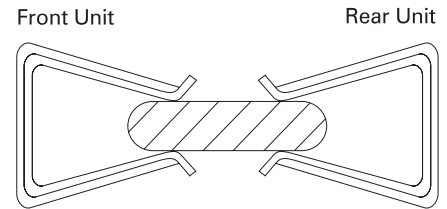

Back-to-Back Mounted Units


Basic Construction

The copper bus of the System/89 has heavy-duty bus insulators. Vertical busses are insulated and isolated from each other. Combination motor control units can be interchanged and are easily rearranged. The unit support brackets can be repositioned to accommodate various size units.

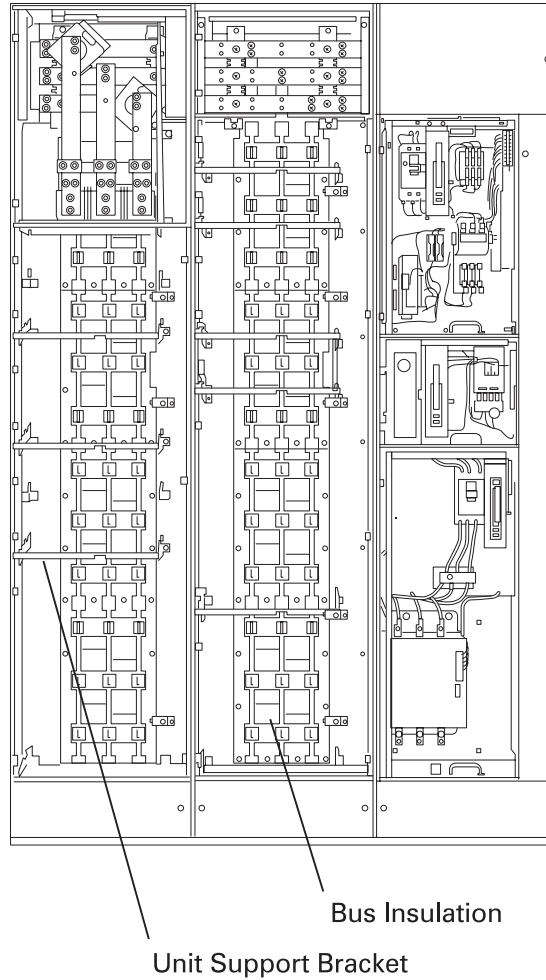


Horizontal Bus

The horizontal bus is connected to the vertical bus with a two-bolt, U-shaped clamp utilizing spring washers to maintain torque. This allows the bolts to be tightened from the front.




Horizontal bus bars are shielded by a clear polycarbonate cover for safety and easy visibility for inspection.

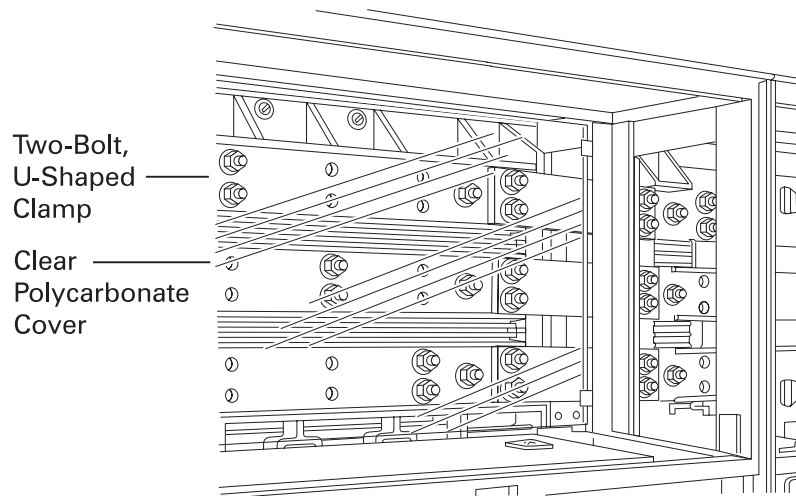


Ground Bus

A horizontal ground bus is mounted in the bottom 6" of space. The horizontal ground bus is standard. An optional vertical ground bus can be connected to the horizontal bus. When a combination motor control unit is inserted into the MCC the vertical ground bus is the first item engaged. Likewise, when the unit is removed the vertical ground bus is the last thing to be disengaged.

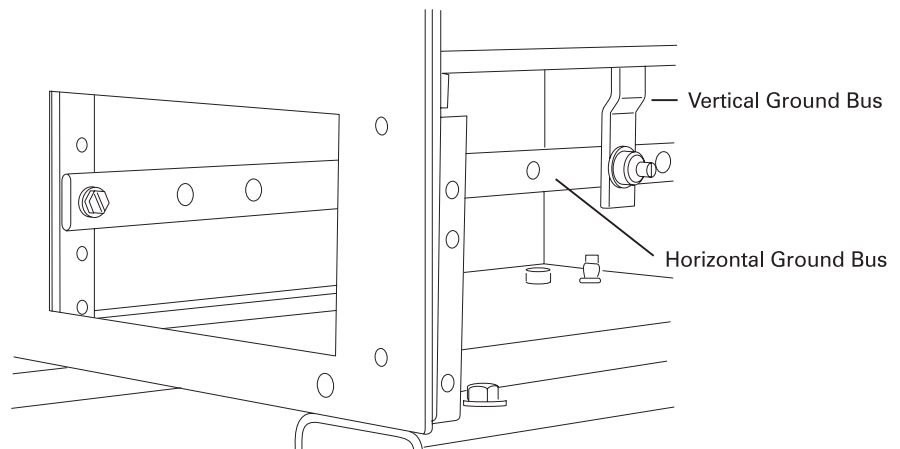


Wire Tie Rods

Round wire tie rods are located in each vertical wireway to hold wire harnesses in place.

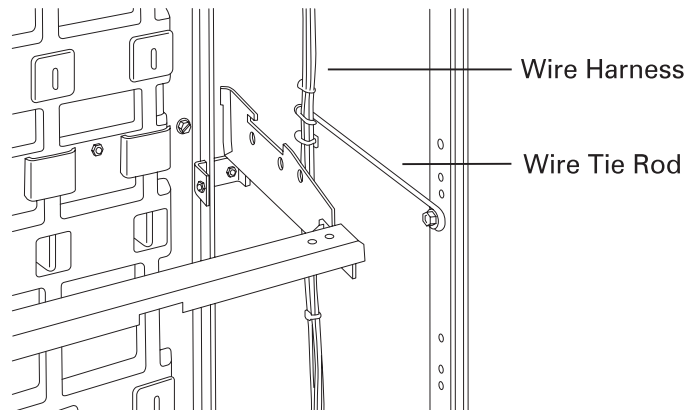


Pilot Devices

Pilot devices are mounted on a panel which latches onto the unit door with a simple tab-and-notch mechanism. The pilot-device panel can be removed from the door and attached to the combination motor control unit for service or unit removal. There is room for four 30mm pilot devices on the panel.

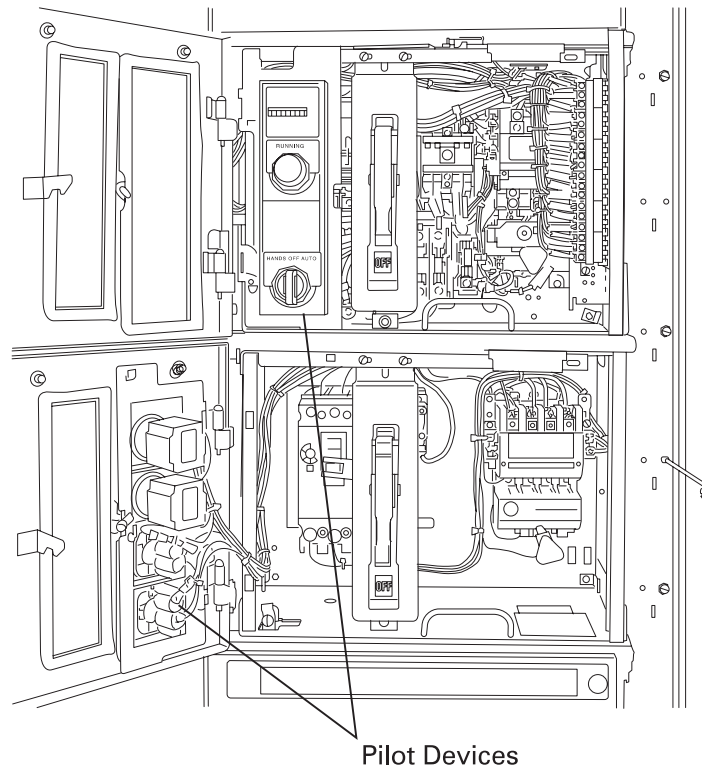

Terminal Blocks

Terminal blocks are supplied with Type B and C wiring. The terminal blocks are mounted up front on a swing-out side panel. The panel is notched so that the terminal block can be placed inside the unit, in a center position, or in the vertical wireway. This secures the terminals inside the unit when access is not required, or allows access from the vertical wireway. Pull-apart terminals are available as an option.

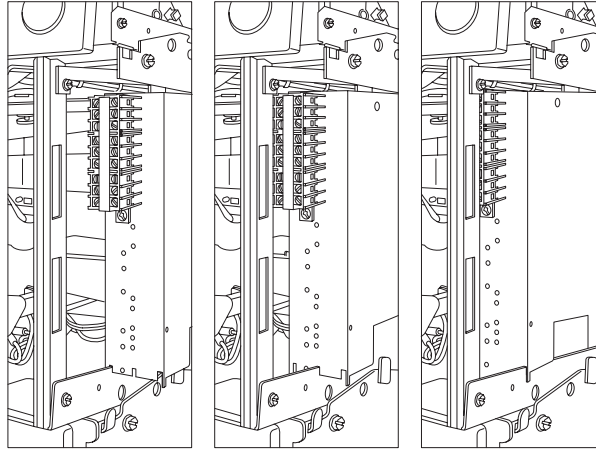


Terminal Block
in Vertical Wireway

Terminal Block
in Center Position

Terminal Block
in Control Unit


Operating Handle

The disconnect operating handle has four positions. When placed in the "PARK" position the unit door can be opened without the handle interfering. The "TRIPPED" position is clearly indicated.

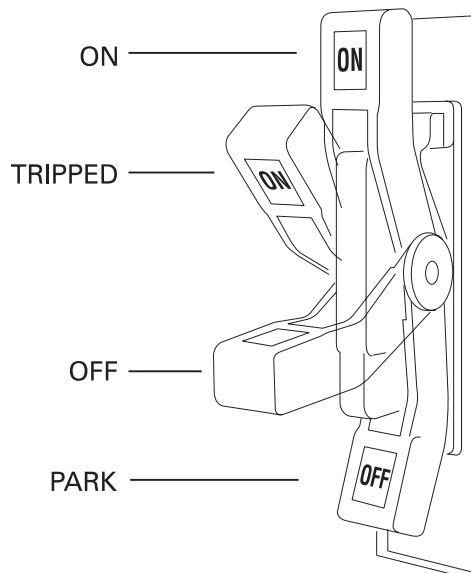


Racking Lever

A racking lever located on each combination motor control unit is used to remove or install the unit. When the operator handle is in the "ON" position, a locking pin blocks the racking lever closed. When the operator handle is switched to the "OFF" position, the locking pin disengages the racking lever. The combination motor control unit can be pulled to a test position. The operator handle is placed in "PARK" to completely remove the combination motor control unit. The unit is designed so that it cannot be inserted or removed with the operator handle in the "ON" position. In the test position the unit can be padlocked in place.

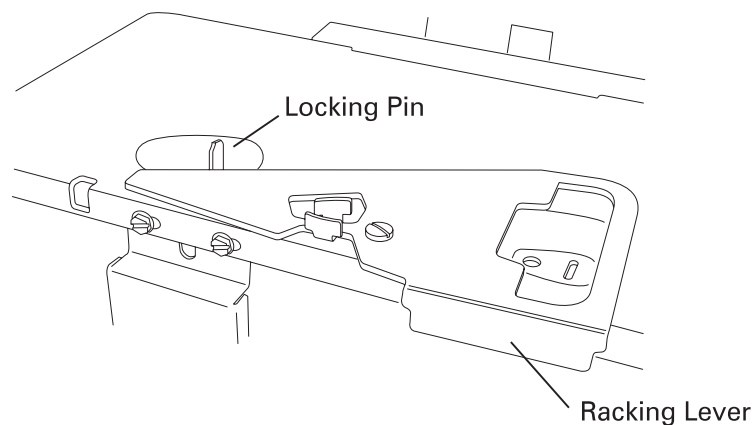


Ground Clip

A copper clip on the side of the combination motor control unit engages the unit support bracket, grounding the unit to the motor control center at all times. An optional vertical bus stab is mounted on the unit when a vertical ground bus is used.

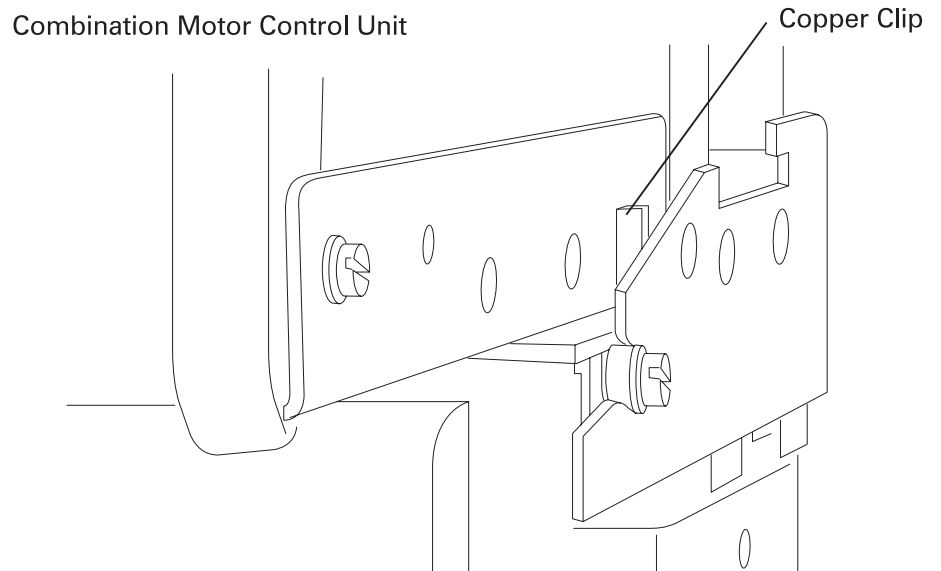


The disconnect operating handle can be locked in the "OFF" position with up to three padlocks.

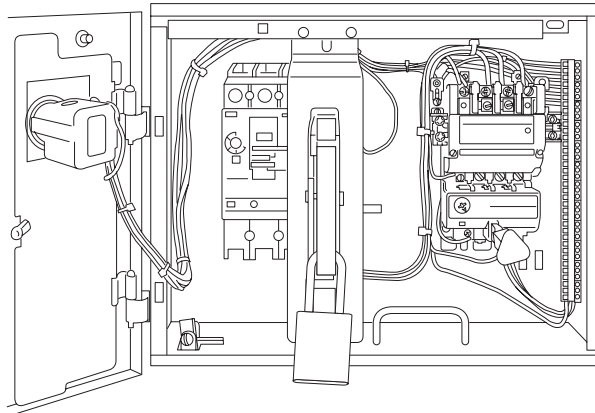


High Density Units

System/89 is also available with high density units. High density units are 6" tall. A maximum of 12 high density units can be installed in 72" of vertical space. High density combination motor control units are available in NEMA size 0 (5 HP) and size 1 (10 HP). To compliment the high density unit, a 24" wide structure is available with an oversized (8" wide) vertical wireway. While the 24" wide structure allows for the increased quantity of wires typical of high density applications, they are not required when high density units are used.

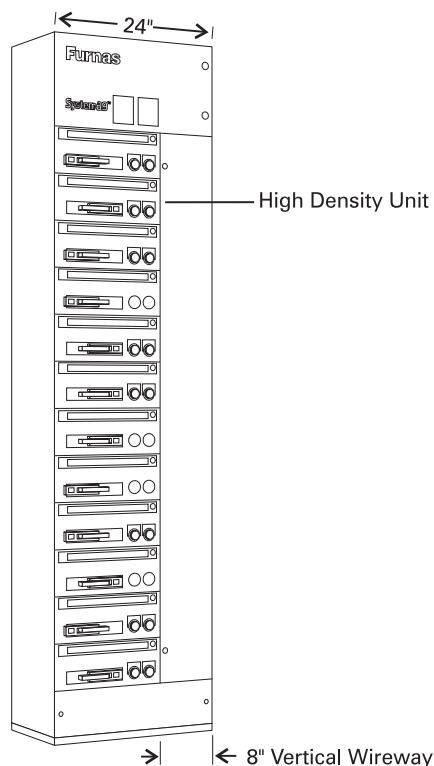


Combination Units

High density units have many of the same features as the full size units. The disconnect operating handle is mounted sideways. When Type B or C wiring is specified, a swing-out terminal block is supplied.

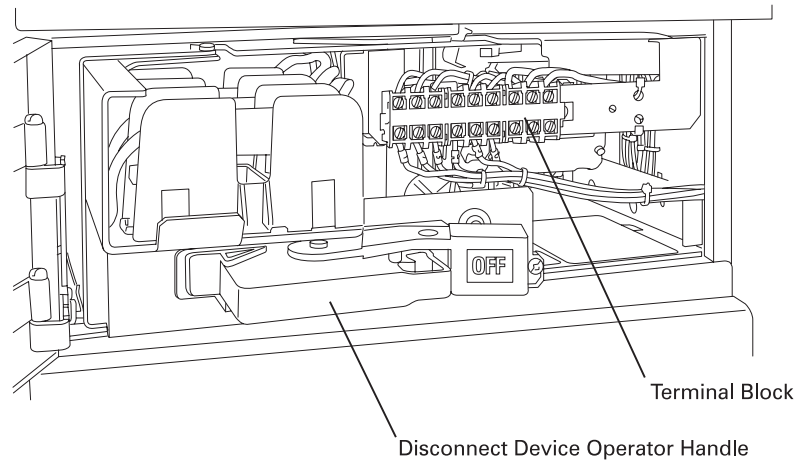


The motor starter is located behind the terminal block. The disconnect device is located behind the operator handle and underneath a fuse block. Fuses may be replaced with a circuit breaker. A unique "swing out" feature permits components to swing out of the unit for easy inspection or maintenance.

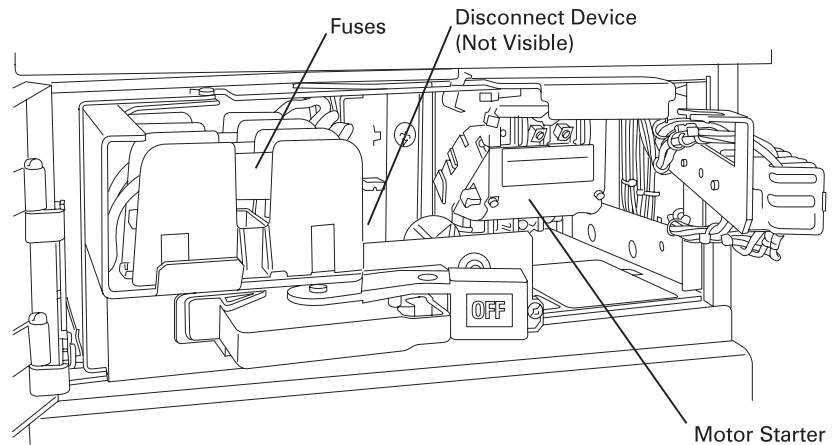


Model 95 Plus

Siemens also manufactures the Model 95 Plus motor control center. The Model 95 Plus has many of the same features as the System/89™ in addition to features unique to the Model 95 Plus.

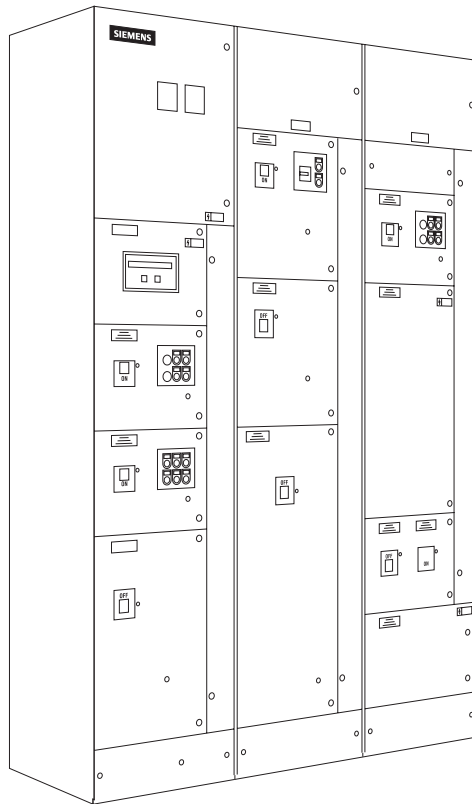

Dimensions

The standard Model 95 Plus MCC nominal height is 90". Overall height is 91 1/8" including standard 1 1/8" base channels. Front-only units can either be 15" or 20" deep. There is a 12"-high wireway on the top of the vertical unit and a 6"-high wireway on the bottom. The vertical wireway on the side is 4" wide. An 8"-wide vertical wireway is available as an option. Vertical units are 20" wide with a 4" wireway or 24" wide with an 8" wireway.

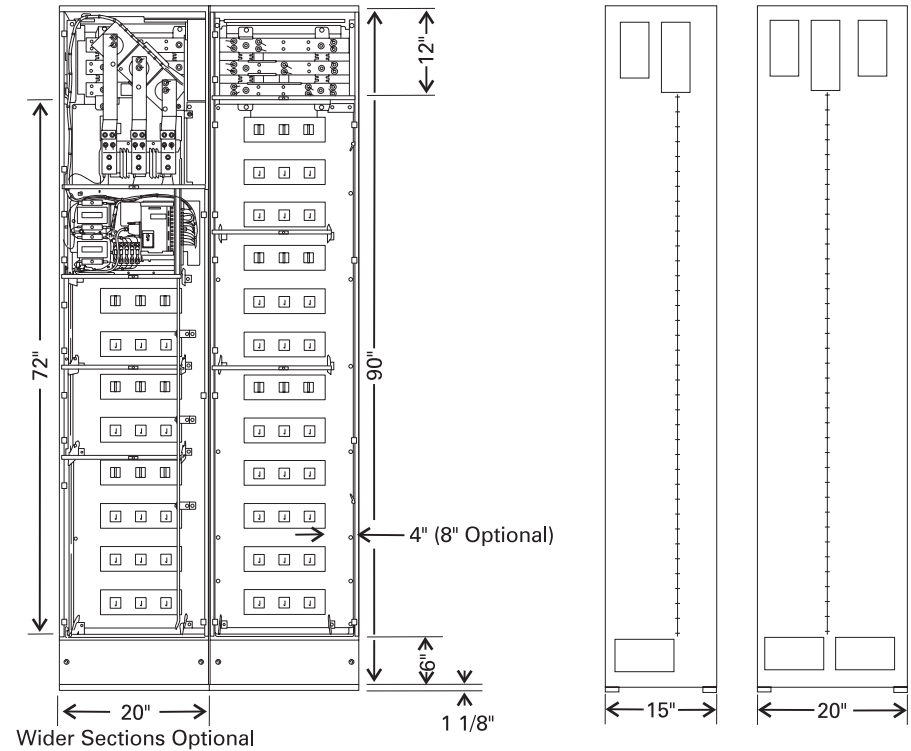


Front View

Side View


Back-to-Back Units

A feature of the Model 95 Plus is the ability to mount combination motor control units back to back. This permits mounting 12 combination motor control units in 72" of vertical space. Model 95 Plus vertical units designed for back-to-back mounting are 21" deep.

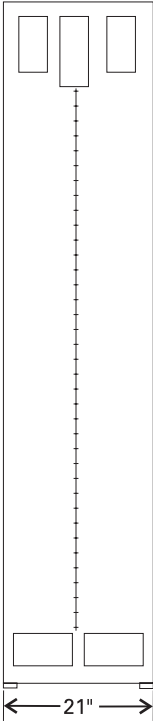


Basic Construction

The copper bus of the Model 95 Plus has heavy-duty bus insulators. Vertical busses are insulated from each other. Combination motor control units can be interchanged and are easily rearranged. The unit support brackets can be repositioned to accommodate various sizes of units.

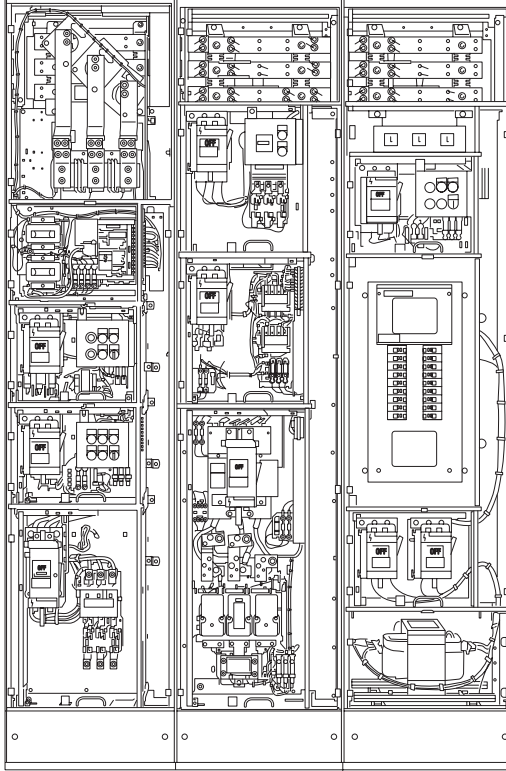


Bus Layout

The horizontal and vertical bus are connected together with a two-bolt, U-shaped clamp (rear view shown below). Connections are front accessible.

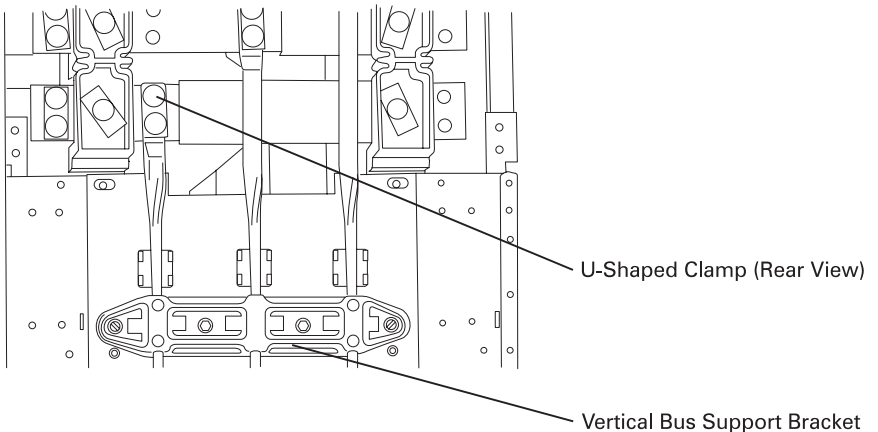


Ground Bus

An optional vertical ground bus connects to a horizontal ground bus located in the bottom 6" of space.

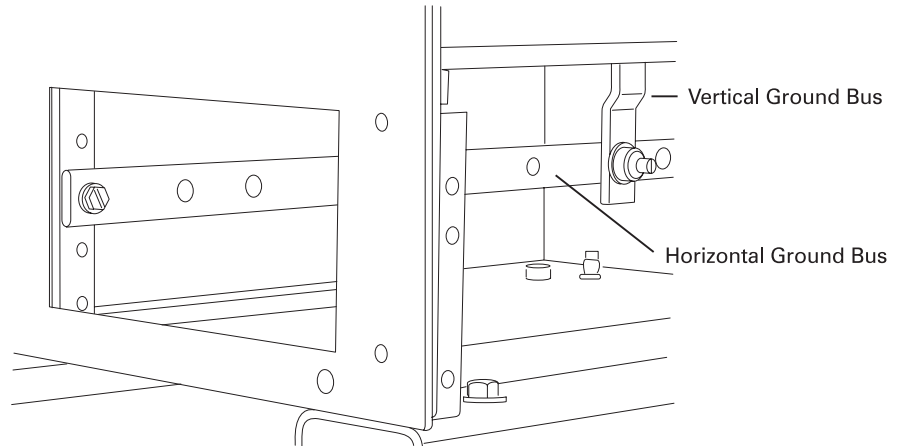


Combination Motor Control Unit

The combination motor control unit is similar to the unit used on the System/89. The units are designed for easy removal and servicing. Stab clips are used for quick bus connect and disconnect.

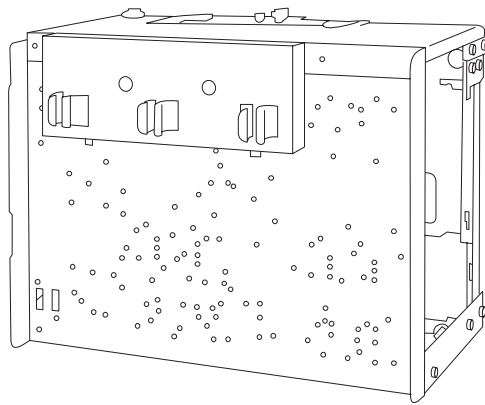


Operating Handle

The operating handle has a large display for "On", "Off", and "Trip". The handle can be padlocked in the "Off" position.

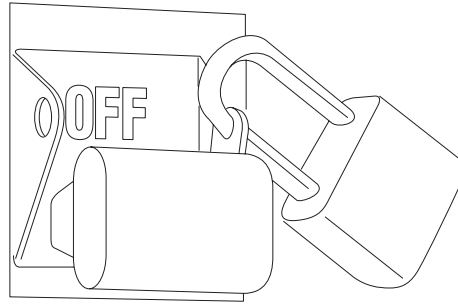


Pilot Devices

Pilot devices are mounted on a hinged panel. There is room for six 22 mm pilot devices on the panel.

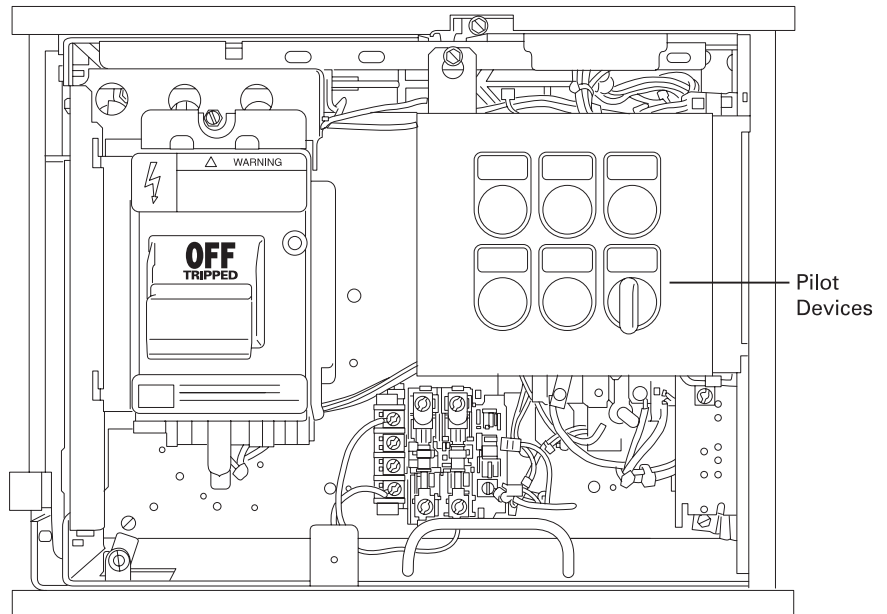


The panel swings open to access the interior of the combination motor control unit.

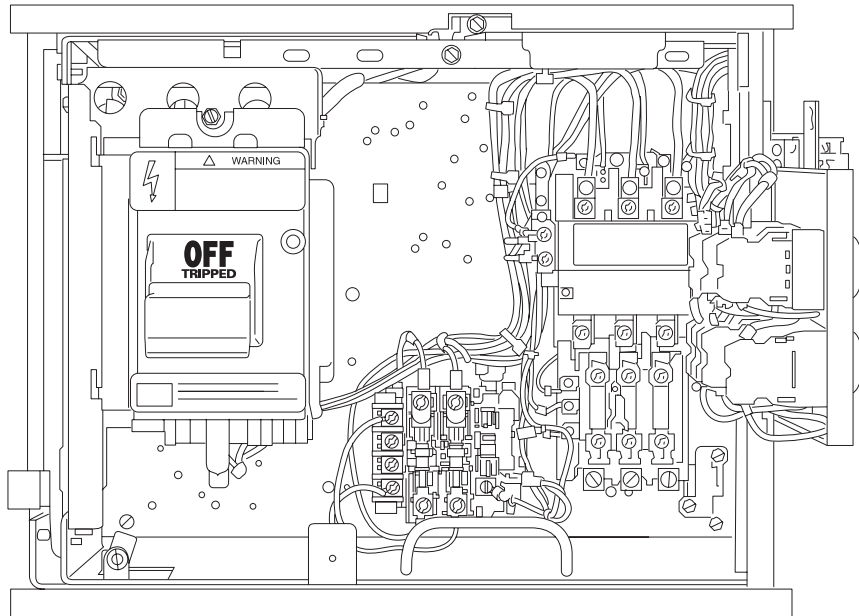

Terminal Blocks

Terminal blocks are on a swing-out panel. In the following illustration the panel is positioned in the vertical wireway for easy access.

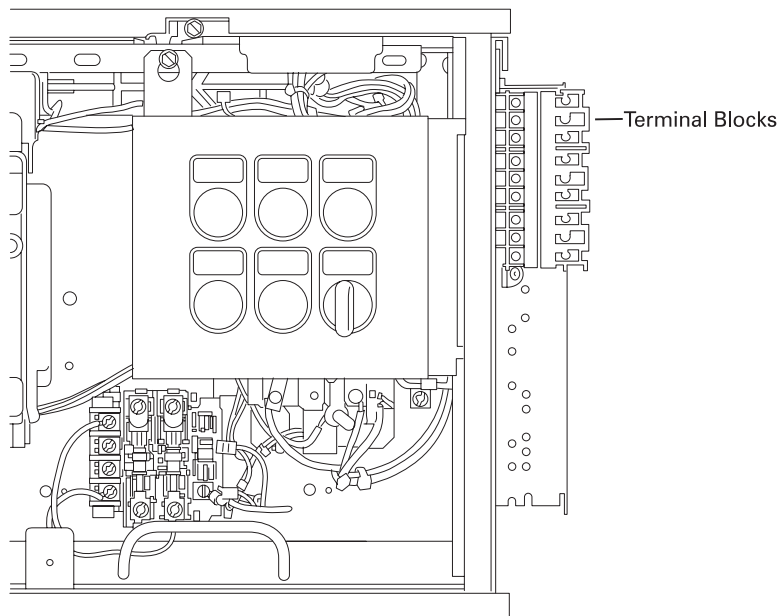

Information Needed to Order MCCs

When ordering a motor control center several questions need to be answered. The following information will be useful.

- Voltage, frequency, number of phases, and available fault current of power supply
- Incoming power requirements (main circuit breaker, main fusible switch, main lugs only, or splicing to existing MCC)
- Amp rating of the horizontal bus and finish material (tin or silver)
- Voltage rating and source of control power
- Size, type (aluminum or copper), number per phase and location of incoming cables or busway and outgoing cables
- Enclosure
 - Type, finish
 - Accessibility (front, rear, or both)
 - Clearance for door swing
 - Restrictions on height, width, and depth
- Horsepower rating and motor design of motors to be controlled
- Ampacity of feeder tap units and unit disconnect devices
- Type of disconnect for units: thermal-magnetic, instantaneous trip, or fusible
- Ground bus requirements
- Types of starting method of combination motor-control units, such as FVNR, FVR, 2S1W, 2S2W, PW, or RVAT
- Type of control circuit for units

- Service entrance requirements
- Vertical bus requirements (finish, isolated/insulated, amp rating)
- Class and Type of wiring
- Additional equipment requirements (transformers, panelboards, transfer switches, PLCs, etc.)
- Preferred layout of units
- Special features, codes, or restrictions
- Customer specifications
- Drawing requirements

Review 6

1. The maximum height of an optional pull box for the System/89 is _____ inches.
2. A maximum of _____ pilot devices can be mounted on the combination motor control unit of the System/89.
3. A maximum of _____ high density units can be mounted in 72" of vertical space.
4. High Density units are available in NEMA size _____ and NEMA size _____ .
5. The top wireway in both the System/89 and the Model 95 Plus is _____ inches high.
6. A maximum of _____ 22 mm pilot devices can be mounted on a Model 95 Plus combination motor control unit.
7. Vertical space for both the Model 95 Plus and the System/89 is _____ inches.
8. The horizontal ground bus for both the Model 95 Plus and the System/89 is located in the _____ 6" of space.
9. System/89 back-to-back units are _____ inches deep.

Review Answers

Review 1

1) d; 2) System/89 and Model 95 Plus; 3) 3; 4) 2.

Review 2

1) Underwriters Laboratories; 2) National Fire Protection Association; 3) 200,000; 4) 430-94.

Review 3

1) B; 2) 80; 3) B; 4) A; 5) B.

Review 4

1) 10; 2) 3; 3) 200; 4) f; 5) Nordic.

Review 5

1) 2000; 2) 100,000; 3) IP14; 4) a=A, b=B-t, c=B-d, d=C

Review 6

1) 24; 2) 4; 3) 12; 4) 0 and 1; 5) 12; 6) 6; 7) 72; 8) bottom; 9) 21.

Final Exam

The final exam is intended to be a learning tool. The book may be used during the exam. A tear-out answer sheet is provided. After completing the test, mail the answer sheet in for grading. A grade of 70% or better is passing. Upon successful completion of the test a certificate will be issued.

Questions

1. The two models of motor control centers manufactured by Siemens are the _____ .
 - a. Nordic and System/89
 - b. Nordic and Model 95 Plus
 - c. INNOVA PLUS and ESP100
 - d. Model 95 Plus and System/89

2. Article _____ of the *National Electrical Code*[®] requires overcurrent protection for MCCs.
 - a. 430-94
 - b. 240
 - c. ICS-1-322
 - d. 430-97

3. Which of the following is not a part of the NEMA definition for motor control centers?
 - a. Principally contains branch circuit protection
 - b. Floor-mounted assemblies
 - c. Common horizontal bus
 - d. One or more vertical sections

4. The standard height of a vertical section is _____ inches.
 - a. 72
 - b. 40
 - c. 90
 - d. 20

5. The maximum shipping width of a motor control center assembly is _____ inches.
- a. 60"
 - b. 80"
 - c. 90"
 - d. 120"
6. According to *NEC*® Article 430-97, there should be a minimum distance of _____ inch(es) of clearance between a live bus and ground.
- a. 1
 - b. 2
 - c. 3
 - d. 4
7. A Class 20 overload relay will trip within _____ seconds when motor current is 600%.
- a. 3
 - b. 10
 - c. 20
 - d. 30
8. The _____ is an overload relay that will trip within three seconds of loss of one of the power supply phases.
- a. INNOVA PLUS melting alloy
 - b. INNOVA PLUS compensated bimetal
 - c. FVNR
 - d. ESP100
9. A NEMA size 3 controller is rated for _____ HP at 480 volts.
- a. 3
 - b. 25
 - c. 50
 - d. 100
10. Motor control centers are rated for _____ volts.
- a. 480
 - b. 600
 - c. 1000
 - d. 1200

11. The maximum current rating for the vertical bus available on the System/89 and the Model 95 Plus is _____ amps.
- a. 300
 - b. 600
 - c. 1600
 - d. 2000
12. Siemens motor control centers are manufactured with a maximum temperature rise of _____ over 40°C ambient.
- a. 25°C
 - b. 50°C
 - c. 65°C
 - d. 75°C
13. Type B-t wiring can be used on starters up to size _____ .
- a. 3
 - b. 5
 - c. 6
 - d. 7
14. No terminal blocks are supplied on Class I, Type _____ wiring.
- a. A
 - b. B-t
 - c. B-d
 - d. C
15. Type _____ wiring is not available on Class II motor control centers.
- a. all types are available on Class II
 - b. A
 - c. B
 - d. C

16. The primary standards for MCCs are established by _____ .
- ANSI, IEEE, IEC
 - ANSI, NEC, IEC
 - UL, IEEE, NEMA
 - UL, NEMA, *NEC*®
17. System/89 high density units take up _____ inches of vertical space.
- 18
 - 12
 - 6
 - 4
18. Most Siemens plug-in combination motor control units use _____ for quick bus connect and disconnect.
- pull-apart terminal blocks
 - two-bolt, U-shaped clamp
 - shelf-brackets
 - stab clips
19. To remove a combination motor control unit from a System/89 MCC, the operating handle is placed in _____ .
- On
 - Off
 - Park
 - Tripped
20. _____ will allow the use of branch circuit protective units in a motor control center provided their use does not make up a major portion of the motor control center.
- NEMA (ICS-2-322)
 - NEC*® (430-97)
 - NEC*® (430-94)
 - UL (845)

Notes